

# TOSHIBA

**INSTALLATION MANUAL**  
**AIR CONDITIONER (SPLIT TYPE)**



***INVERTER***



**Indoor unit**  
**RAS-18, 24PKCV-AE**

**Outdoor unit**  
**RAS-18, 24PACV-AE**



1120650182-1

<b>PRECAUTIONS FOR SAFETY</b> .....	1
<b>ACCESSORY PARTS</b> .....	4
<b>INSTALLATION DIAGRAM OF INDOOR AND OUTDOOR UNITS</b> .....	5
■ Optional Installation Parts .....	5
<b>INDOOR UNIT</b> .....	6
■ Installation Place .....	6
■ Cutting a Hole and Mounting Installation Plate .....	6
■ Piping and Drain Hose Installation .....	6
■ Indoor Unit Fixing .....	7
■ Drainage.....	8
<b>OUTDOOR UNIT</b> .....	8
■ Installation Place .....	8
■ Draining the Water .....	8
■ Refrigerant Piping Connection .....	9
■ Evacuating .....	9
<b>ELECTRICAL WORKS</b> .....	11
■ Wiring Connection .....	11
■ Power Supply and Connecting Cable Connection .....	12
<b>OTHERS</b> .....	13
■ Gas Leak Test .....	13
■ Remote Control A-B Selection .....	13
■ Test Operation.....	13
■ Auto Restart Setting .....	13
<b>APPENDIX</b> .....	14

## PRECAUTIONS FOR SAFETY

- Before installation, please read these precautions for safety carefully.
- Be sure to follow the precautions provided here to avoid safety risks. The symbols and their meanings are shown below.

**WARNING** : It indicates that incorrect use of this unit may cause severe injury or death.

**CAUTION** : It indicates that incorrect use of this unit may cause personal injury (\*1), or property damage (\*2).

\*1: Personal injury means a slight accident, burn, or electrical shock which does not require admission or repeated hospital treatment.

\*2: Property damage means greater damage which affects assets or resources.

### For general public use

Power supply cord and connecting cable of appliance use shall be at least poly-chloroprene sheathed flexible cord (design H07RN-F) or cord designation 60245 IEC66. (Shall be installed in accordance with national wiring regulations.)

### CAUTION

#### New refrigerant air conditioner installation

- **THIS AIR CONDITIONER USES THE NEW HFC REFRIGERANT (R410A), WHICH DOES NOT DESTROY THE OZONE LAYER.**

R410A refrigerant is apt to be affected by impurities such as water, oxidizing membranes, and oils because the pressure of R410A refrigerant is approx. 1.6 times of refrigerant R22. As well as the adoption of this new refrigerant, refrigerating machine oil has also been changed. Therefore, during installation work, be sure that water, dust, former refrigerant, or refrigerating machine oil does not enter the refrigeration cycle of a new-refrigerant air conditioner.

To avoid mixing refrigerant and refrigerating machine oil, the sizes of charging port connecting sections on the main unit are different from those for the conventional refrigerant, and different size tools are also required. For connecting pipes, use new and clean piping materials with high pressure withstand capabilities, designed for R410A only, and ensure that water or dust does not enter. Moreover, do not use any existing piping as its pressure withstand may be insufficient and may contain impurities.

**CAUTION****To disconnect the appliance from the main power supply**

This appliance must be connected to the main power supply by means of a abreaker or a switch with a contact separation of at least 3 mm in all poles.

**DANGER**

- FOR USE BY QUALIFIED PERSONS ONLY.
- TURN OFF MAIN POWER SUPPLY BEFORE ATTEMPTING ANY ELECTRICAL WORK. MAKE SURE ALL POWER SWITCHES ARE OFF. FAILURE TO DO SO MAY CAUSE ELECTRIC SHOCK.
- CONNECT THE CONNECTING CABLE CORRECTLY. IF THE CONNECTING CABLE IS CONNECTED WRONGLY, ELECTRIC PARTS MAY BE DAMAGED.
- CHECK THE EARTH WIRE THAT IT IS NOT BROKEN OR DISCONNECTED BEFORE INSTALLATION.
- DO NOT INSTALL NEAR CONCENTRATIONS OF COMBUSTIBLE GAS OR GAS VAPORS. FAILURE TO FOLLOW THIS INSTRUCTION CAN RESULT IN FIRE OR EXPLOSION.
- TO PREVENT OVERHEATING THE INDOOR UNIT AND CAUSING A FIRE HAZARD, PLACE THE UNIT WELL AWAY (MORE THAN 2 M) FROM HEAT SOURCES SUCH AS RADIATORS, HEATERS, FURNACE, STOVES, ETC.
- WHEN MOVING THE AIR CONDITIONER FOR INSTALLING IT IN ANOTHER PLACE AGAIN, BE VERY CAREFUL NOT TO GET THE SPECIFIED REFRIGERANT (R410A) WITH ANY OTHER GASEOUS BODY INTO THE REFRIGERATION CYCLE. IF AIR OR ANY OTHER GAS IS MIXED IN THE REFRIGERANT, THE GAS PRESSURE IN THE REFRIGERATION CYCLE BECOMES ABNORMALLY HIGH AND IT RESULTINGLY CAUSES BURST OF THE PIPE AND INJURIES ON PERSONS.
- IN THE EVENT THAT THE REFRIGERANT GAS LEAKS OUT OF THE PIPE DURING THE INSTALLATION WORK, IMMEDIATELY LET FRESH AIR INTO THE ROOM. IF THE REFRIGERANT GAS IS HEATED BY FIRE OR SOME THING ELSE, IT CAUSES GENERATION OF POISONOUS GAS.

## **WARNING**

- Never modify this unit by removing any of the safety guards or bypassing any of the safety interlock switches.
- Do not install in a place which cannot bear the weight of the unit.  
Personal injury and property damage can result if the unit falls.
- Before doing the electrical work, attach an approved plug to the power supply cord.  
Also, make sure the equipment is properly earthed.
- Appliance shall be installed in accordance with national wiring regulations.  
If you detect any damage, do not install the unit. Contact your dealer immediately.
- Do not use any refrigerant different from the one specified for complement or replacement.  
Otherwise, abnormally high pressure may be generated in the refrigeration cycle, which may result in a failure or explosion of the product or an injury to your body.

## **CAUTION**

- Exposure of unit to water or other moisture before installation could result in electric shock.  
Do not store it in a wet basement or expose to rain or water.
- After unpacking the unit, examine it carefully for possible damage.
- Do not install in a place that can increase the vibration of the unit. Do not install in a place that can amplify the noise level of the unit or where noise and discharged air might disturb neighbors.
- To avoid personal injury, be careful when handling parts with sharp edges.
- Please read this installation manual carefully before installing the unit.  
It contains further important instructions for proper installation.
- The manufacturer shall not assume any liability for the damage caused by not observing the description of this manual.

## **REQUIREMENT OF REPORT TO THE LOCAL POWER SUPPLIER**

Please make absolutely sure that the installation of this appliance is reported to the local power supplier before installation. If you experience any problems or if the installation is not accepted by the supplier, the service agency will take adequate countermeasures.

# ACCESSORY PARTS

Indoor Unit			
No.	Part name	No.	Part name
①	 Installation plate × 1	②	 Wireless remote control × 1
③	 Battery × 2	④	 Remote control holder × 1
⑤	 Toshiba new IAQ filter × 2	⑥	 Mounting screw × 6
⑦	 Flat head wood screw × 2	⑧	 Owner's Manual × 1
⑨	 Installation Manual × 1	⑩	 Screw × 2

Outdoor Unit			
No.	Part name	No.	Part name
⑪	 Drain nipple × 1	⑫	 Cap water proof × 2

### Air filters

Clean every 2 weeks.

1. Open the air inlet grille.
2. Remove the air filters.
3. Vacuum or wash and then dry them.
4. Reinstall the air filters and close the air inlet grille.


### Filter

Maintenance & Shelf-life


Clean every 3-6 months when dust tuck or covers the filter.

1. Recommend to use vacuum to clean by sucking the dusts which stick or dip inside the filter or use the blower to blow the dust go out through the filter.
2. If necessary to use water to clean, simply use the plain water to wash the filter, dry with the sunlight for 3-4 hours or until it completely dry. Nevertheless, use hair drier to dry it. However, washing with water, it may reduce the performance of the filter.
3. Replace every 2 years or sooner. (contact your dealer to purchase new filter) (P/N : RB-A620DE)


Note: Filter life depends on the level of impurities in your operating environment. Higher levels of impurities may require more frequent cleaning and replacement. In all cases, we recommend an additional set of filters to improve the purifying and deodorizing performance of your air conditioner.

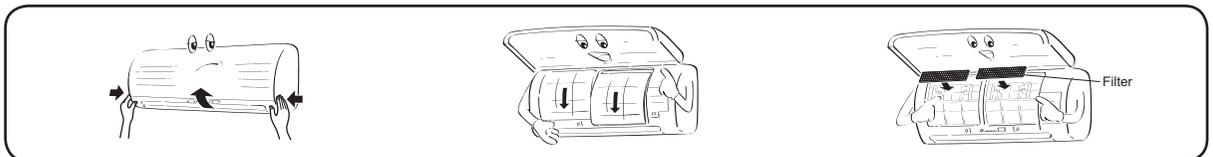

# INSTALLATION DIAGRAM OF INDOOR AND OUTDOOR UNITS

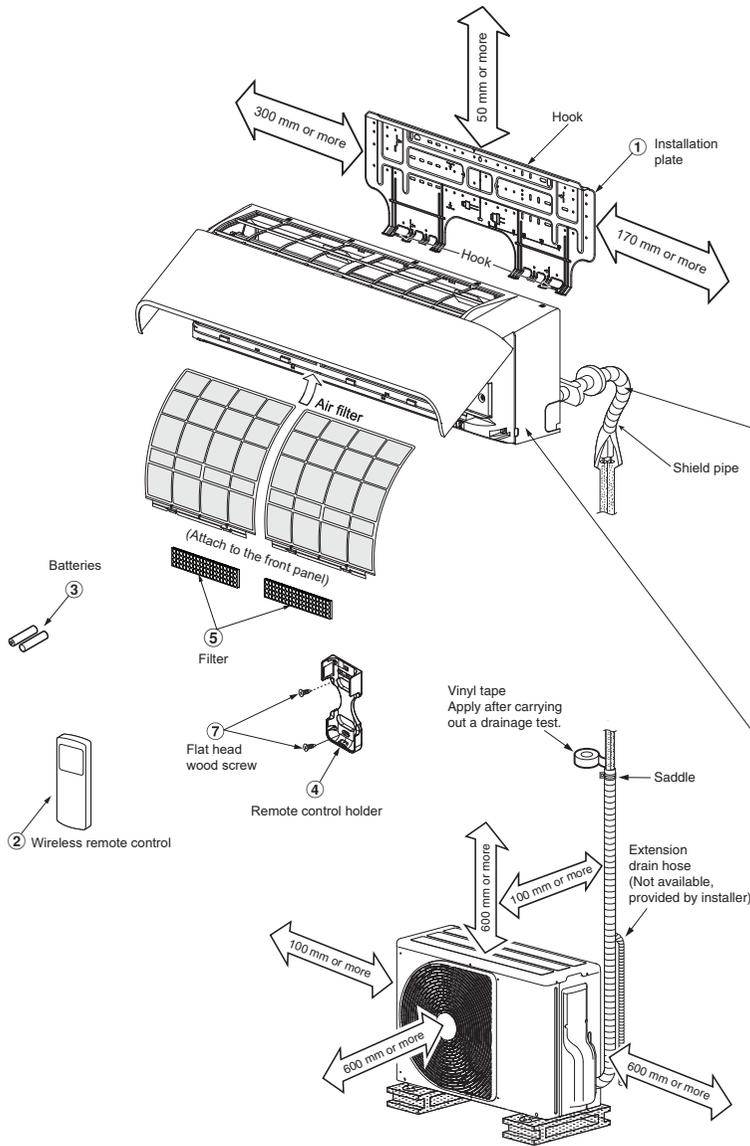


For the rear left, bottom left and left piping

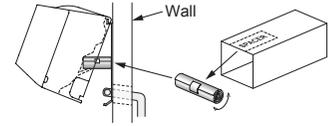


Cut out a piece of SPACER from indoor unit packaging box, roll it and insert between the indoor unit and wall to tilt the indoor unit for better operation.

Do not allow the drain hose to get slack.




Make sure to run the drain hose sloped downward.

The auxiliary piping can be connected to the left, rear left, rear right, right, bottom right or bottom left.



Insulate the refrigerant pipes separately with insulation, not together.




8 mm thick heat resisting polyethylene foam

## Optional Installation Parts


Part code	Parts name	Q'ty
A	Refrigerant piping Liquid side : Ø6.35 mm Gas side : Ø12.70 mm (For 18k) : Ø15.88 mm (For 24k)	One each
B	Pipe insulating material (polyethylene foam, 8 mm thick)	1
C	Putty, PVC tapes	One each

## Fixing bolt arrangement of outdoor unit

- Secure the outdoor unit with fixing bolts and nuts if the unit is likely to be exposed to a strong wind.
- Use Ø8 mm or Ø10 mm anchor bolts and nuts.
- If it is necessary to drain the defrost water, attach drain nipple (11) and cap water proof (12) to the bottom plate of the outdoor unit before installing it.



For 18k



For 24k

# INDOOR UNIT

## Installation Place


- A place which provides the spaces around the indoor unit as shown in the diagram
- A place where there are no obstacles near the air inlet and outlet
- A place which allows easy installation of the piping to the outdoor unit
- A place which allows the front panel to be opened
- The indoor unit shall be installed at least 2.5 m height. Also, it must be avoided to put anything on the top of the indoor unit.

### CAUTION

- Direct sunlight to the indoor unit's wireless receiver should be avoided.
- The microprocessor in the indoor unit should not be too close to RF noise sources.  
(For details, see the owner's manual.)

## Remote control


- A place where there are no obstacles such as a curtain that may block the signal from the indoor unit.
- Do not install the remote control in a place exposed to direct sunlight or close to a heating source such as a stove.
- Keep the remote control at least 1 m apart from the nearest TV set or stereo equipment.  
(This is necessary to prevent image disturbances or noise interference.)
- The location of the remote control should be determined as shown below.

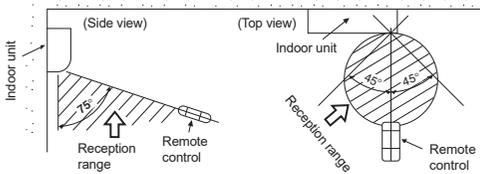

## Cutting a Hole and Mounting Installation Plate

### Cutting a hole

When installing the refrigerant pipes from the rear

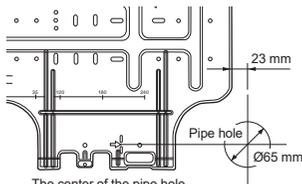


1. After determining the pipe hole position on the mounting plate (➡), drill the pipe hole (Ø65 mm) at a slight downward slant to the outdoor side.

### NOTE

- When drilling a wall that contains a metal lath, wire lath or metal plate, be sure to use a pipe hole brim ring sold separately.

## Mounting the installation plate

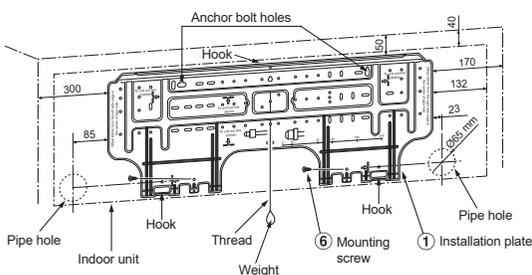


## When the installation plate is directly mounted on the wall

1. Securely fit the installation plate onto the wall by screwing it in the upper and lower parts to hook up the indoor unit.
2. To mount the installation plate on a concrete wall with anchor bolts, use the anchor bolt holes as illustrated in the below figure.
3. Install the installation plate horizontally in the wall.

### CAUTION

When installing the installation plate with a mounting screw, do not use the anchor bolt holes. Otherwise, the unit may fall down and result in personal injury and property damage.

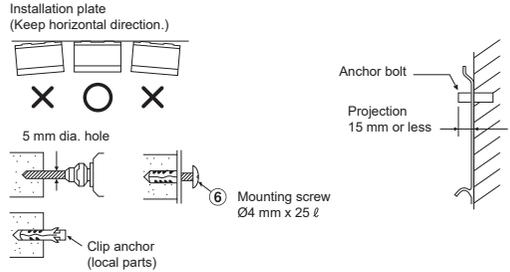

### CAUTION

Failure to firmly install the unit may result in personal injury and property damage if the unit falls.

- In case of block, brick, concrete or similar type walls, make 5 mm dia. holes in the wall.
- Insert clip anchors for appropriate mounting screws (⑥).


### NOTE

- Secure four corners and lower parts of the installation plate with 4 to 6 mounting screws to install it.

## Piping and Drain Hose Installation

### Piping and drain hose forming

- Since dewing results in a machine trouble, make sure to insulate both connecting pipes. (Use polyethylene foam as insulating material.)

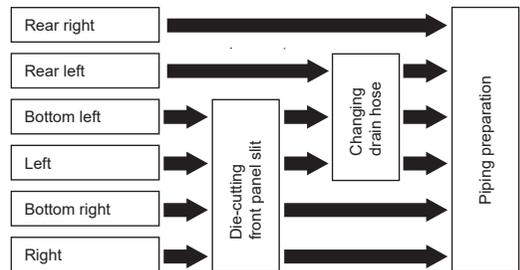

#### 1. Die-cutting front panel slit


Cut out the slit on the left or right side of the front panel for the left or right connection and the slit on the bottom left or right side of the front panel for the bottom left or right connection with a pair of nippers.

#### 2. Changing drain hose

For leftward connection, bottom-leftward connection and rearleftward connection's piping, it is necessary to change the drain hose and drain cap.


### How to remove the drain hose

- The drain hose can be removed by removing the screw securing the drain hose and then pulling out the drain hose.
- When removing the drain hose, be careful of any sharp edges of steel plate. The edges can injure.
- To install the drain hose, insert the drain hose firmly until the connection part contacts with heat insulator, and then secure it with original screw.




### How to remove the drain cap

Clip the drain cap by needle-nose pliers and pull out.




### How to fix the drain cap

- 1) Insert hexagon wrench (4 mm) in a center head.
- 2) Firmly insert the drain cap.



Do not apply lubricating oil (refrigerant machine oil) when inserting the drain cap. Application causes deterioration and drain leakage of the plug.

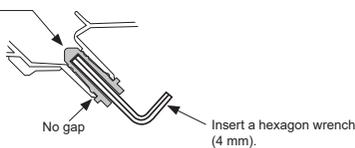


### CAUTION

Firmly insert the drain hose and drain cap; otherwise, water may leak.


### In case of right or left piping

- After scribing slits of the front panel with a knife or a making-off pin, cut them with a pair of nippers or an equivalent tool.



### In case of bottom right or bottom left piping

- After scribing slits of the front panel with a knife or a making-off pin, cut them with a pair of nippers or an equivalent tool.




### Left-hand connection with piping

- Bend the connecting pipe so that it is laid within 43 mm above the wall surface. If the connecting pipe is laid exceeding 43 mm above the wall surface, the indoor unit may unstably be set on the wall. When bending the connecting pipe, make sure to use a spring bender so as not to crush the pipe.

### Bend the connecting pipe within a radius of 30 mm.

To connect the pipe after installation of the unit (figure)

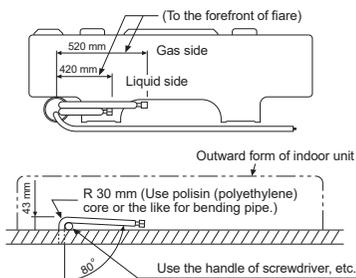


### NOTE

If the pipe is bent incorrectly, the indoor unit may unstably be set on the wall. After passing the connecting pipe through the pipe hole, connect the connecting pipes to the auxiliary pipes and wrap the facing tape around them.

### CAUTION



- Bind the auxiliary pipes (two) and connecting cable with facing tape tightly. In case of leftward piping and rear-leftward piping, bind the auxiliary pipes (two) only with facing tape.

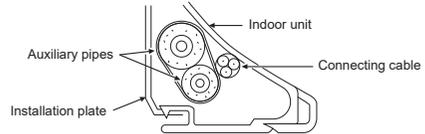


- Carefully arrange pipes so that any pipe does not stick out of the rear plate of the indoor unit.
- Carefully connect the auxiliary pipes and connecting pipes to one another and cut off the insulating tape wound on the connecting pipe to avoid double-taping at the joint; moreover, seal the joint with the vinyl tape, etc.
- Since dewing results in a machine trouble, make sure to insulate both connecting pipes. (Use polyethylene foam as insulating material.)
- When bending a pipe, carefully do it, not to crush it.

## Indoor Unit Fixing

1. Pass the pipe through the hole in the wall and hook the indoor unit on the installation plate at the upper hook.
2. Swing the indoor unit to right and left to confirm that it is firmly hooked up on the installation plate.
3. While pressing the indoor unit onto the wall, hook it at the lower part on the installation plate. Pull the indoor unit toward you to confirm that it is firmly hooked up on the installation plate.




- For detaching the indoor unit from the installation plate, pull the indoor unit toward you while pushing its bottom up at the specified parts.

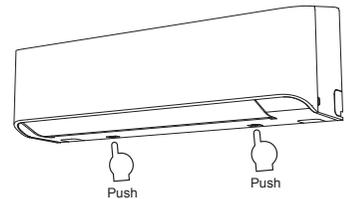

### Information

The lower part of indoor unit may float, due to the condition of piping and you cannot fix it to the installation plate. In that case, use the ⑩ screws provided to fix the unit and the installation plate.




## Drainage


1. Run the drain hose sloped downwards.

### NOTE

- The hole should be made at a slight downward slant on the outdoor side.

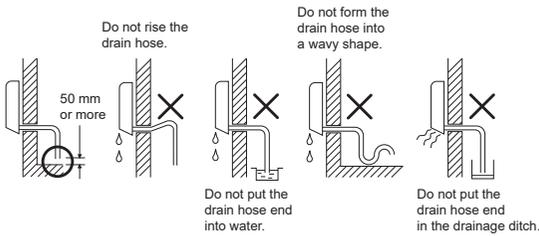


2. Put water in the drain pan and make sure that the water is drained out of doors.
3. When connecting extension drain hose, insulate the connecting part of extension drain hose with shield pipe.



### CAUTION

Arrange the drain pipe for proper drainage from the unit. Improper drainage can result in dew-dropping.

This air conditioner has the structure designed to drain water collected from dew, which forms on the back of the indoor unit, to the drain pan. Therefore, do not store the power cord and other parts at a height above the drain guide.



## OUTDOOR UNIT

### Installation Place

- A place which provides the spaces around the outdoor unit as shown in the diagram
- A place which can bear the weight of the outdoor unit and does not allow an increase in noise level and vibration
- A place where the operation noise and discharged air do not disturb your neighbors
- A place which is not exposed to a strong wind
- A place free of a leakage of combustible gases
- A place which does not block a passage
- When the outdoor unit is to be installed in an elevated position, be sure to secure its feet.
- The allowable length of the connecting pipe.

Model	18k	24k
Chargeless	Up to 15 m	Up to 15 m
Maximum length	20 m	25 m
Additional refrigerant charging	16 m (20 g / 1 m)	16 - 25 m (30 g / 1 m)
Maximum refrigerant charging	1.55 kg	2.20 kg

- The allowable height of outdoor unit installation site.

Model	18k	24k
Maximum height	15 m	15 m

- A place where the drain water does not raise any problems

### Precautions for adding refrigerant

Use a scale having a precision with at least 10 g per index line when adding the refrigerant.


Do not use a bathroom scale or similar instrument.

### CAUTION

When the outdoor unit is installed in a place where the drain water might cause any problems, seal the water leakage point tightly using a silicone adhesive or caulking compound.

### CAUTION

1. Install the outdoor unit without anything blocking the air discharging.
2. When the outdoor unit is installed in a place always exposed to strong wind like a coast or on a high storey of a building, secure the normal fan operation using a duct or a windshield.
3. In particularly windy areas, install the unit such as to avoid admission of wind.
4. Installation in the following places may result in trouble. Do not install the unit in such places.
  - A place full of machine oil
  - A saline-place such as the coast
  - A place full of sulfide gas
  - A place where high-frequency waves are likely to be generated as from audio equipment, welders, and medical equipment




### Draining the Water

- Holes are provided on the base plate of the outdoor unit to ensure that the defrost water produced during heating operations is drained off efficiently. If a centralized drain is required when installing the unit on a balcony or wall, follow the steps below to drain off the water.

1. Proceed with water-proofing by installing the water-proof rubber caps in the 2 elongated holes on the base plate of the outdoor unit.

[How to install the water-proof rubber caps]


- 1) Place four fingers into each cap, and insert the caps into the water drain holes by pushing them into place from the underside of the base plate.
- 2) Press down on the outer circumferences of the caps to ensure that they have been inserted tightly. (Water leaks may result if the caps have not been inserted properly, if their outer circumferences lift up or the caps catch on or wedge against something.)

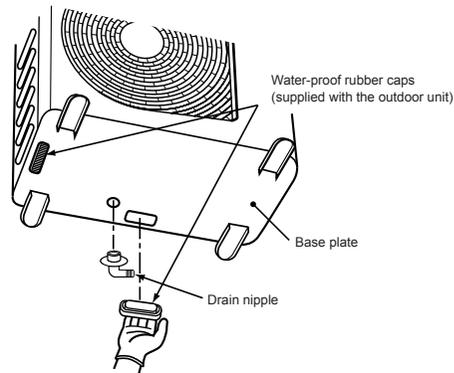

2. Install the drain nipple and a commercially available drain hose (with 16 mm inside diameter), and drain off the water.

(For the position where the drain nipple is installed, refer to the installation diagram of the indoor and outdoor units.)

- Check that the outdoor unit is horizontal, and route the drain hose at a downward sloped angle while ensuring that it is connected tautly.

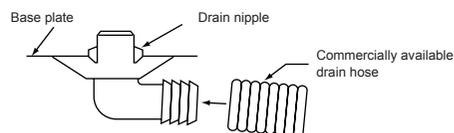

Do not use ordinary garden hose, but one can flatten and prevent water from draining.

## Refrigerant Piping Connection

### Flaring

1. Cut the pipe with a pipe cutter.




2. Insert a flare nut into the pipe and flare the pipe.

- Projection margin in flaring : A (Unit : mm)

RIGID (clutch type)

Outer dia. of copper pipe	R410A tool used	Conventional tool used
Ø6.35	0 to 0.5	1.0 to 1.5
Ø9.52	0 to 0.5	1.0 to 1.5
Ø12.70	0 to 0.5	1.0 to 1.5
Ø15.88	0 to 0.5	1.0 to 1.5
Pipes thickness	0.8 mm or more	



IMPERIAL (wing nut type)


Outer dia. of copper pipe	R410A
Ø6.35	1.5 to 2.0
Ø9.52	1.5 to 2.0
Ø12.70	2.0 to 2.5
Ø15.88	2.0 to 2.5
Pipes thickness	0.8 mm or more

### CAUTION

- Do not scratch the inner surface of the flared part when removing burrs.
- Flare processing under the condition of scratches on the inner surface of flare processing part will cause refrigerant gas leak.

### Tightening connection

Align the centers of the connecting pipes and tighten the flare nut as far as possible with your fingers. Then tighten the nut with a spanner and torque wrench as shown in the figure.

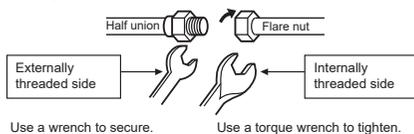

### CAUTION


Do not apply excess torque. Otherwise, the nut may crack depending on the conditions.

(Unit : N·m)

Outer dia. of copper pipe	Tightening torque
Ø6.35 mm	16 to 18 (1.6 to 1.8 kgf·m)
Ø9.52 mm	30 to 42 (3.0 to 4.2 kgf·m)
Ø12.70 mm	50 to 62 (5.0 to 6.2 kgf·m)
Ø15.88 mm	65 to 80 (6.5 to 8.0 kgf·m)

### • Tightening torque of flare pipe connections

The operating pressure of R410A is higher than that of R22 (approx. 1.6 times). It is therefore necessary to firmly tighten the flare pipe connecting sections (which connect the indoor and outdoor units) up to the specified tightening torque. Incorrect connections may cause not only a gas leakage, but also damage to the refrigeration cycle.



## Evacuating

After the piping has been connected to the indoor unit, you can perform the air purge together at once.

### AIR PURGE


Evacuate the air in the connecting pipes and in the indoor unit using a vacuum pump. Do not use the refrigerant in the outdoor unit. For details, see the manual of the vacuum pump.

### Using a vacuum pump

Be sure to use a vacuum pump with counter-flow prevention function so that inside oil of the pump does not flow backward into pipes of the air conditioner when the pump stops.

(If oil inside of the vacuum pump enters the air conditioner, which use R410A, refrigeration cycle trouble may result.)

1. Connect the charge hose from the manifold valve to the service port of the packed valve at gas side.
2. Connect the charge hose to the port of the vacuum pump.
3. Open fully the low pressure side handle of the gauge manifold valve.
4. Operate the vacuum pump to start evacuating. Perform evacuating for about 15 minutes if the piping length is 20 meters. (15 minutes for 20 meters) (assuming a pump capacity of 27 liters per minute) Then confirm that the compound pressure gauge reading is  $-101$  kPa ( $-76$  cmHg).
5. Close the low pressure side valve handle of the gauge manifold valve.
6. Open fully the valve stem of the packed valves (both gas and liquid sides).
7. Remove the charging hose from the service port.
8. Securely tighten the caps on the packed valves.

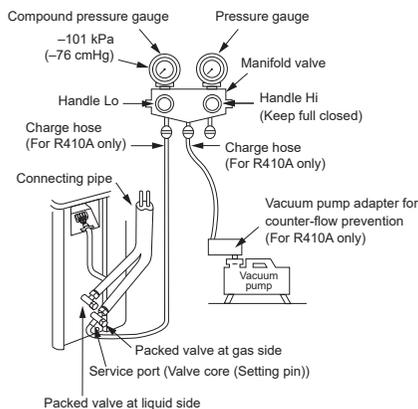

### CAUTION

#### • KEEP IMPORTANT 6 POINTS FOR PIPING WORK.

- (1) Take away dust and moisture (inside of the connecting pipes).
- (2) Tighten the connections (between pipes and unit).
- (3) Evacuate the air in the connecting pipes using a VACUUM PUMP.
- (4) Check gas leak (connected points).
- (5) Be sure to fully open the packed valves before operation.
- (6) Reusable mechanical connectors and flared joints are not allowed indoors. When mechanical connectors are reused indoors, sealing parts shall be renewed. When flared joints are reused indoors, the flare part shall be refabricated.


## Packed valve handling precautions

- Open the valve stem all the way out, but do not try to open it beyond the stopper.

Pipe size of Packed Valve	Size of Hexagon wrench
12.70 mm and smaller	A = 4 mm
15.88 mm	A = 5 mm

- Securely tighten the valve cap with torque in the following table:

Cap	Cap Size (H)	Torque
Valve Rod Cap	H17 - H19	14~18 N·m (1.4 to 1.8 kgf·m)
	H22 - H30	33~42 N·m (3.3 to 4.2 kgf·m)
Service Port Cap	H14	8~12 N·m (0.8 to 1.2 kgf·m)
	H17	14~18 N·m (1.4 to 1.8 kgf·m)

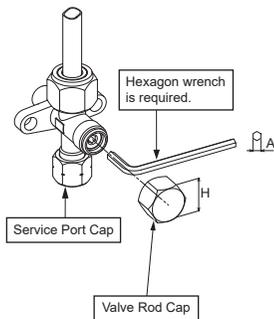

# ELECTRICAL WORKS


Model	18k	24k
Power source	220-240 V, 50 Hz Single phase	
Maximum running current	8.90 A	11.40 A
Circuit breaker rating	11.0 A	14.0 A
Power supply cable	H07RN-F or 60245 IEC66 (2.5 mm <sup>2</sup> or more)	
Connecting cable	H07RN-F or 60245 IEC66 (1.5 mm <sup>2</sup> or more)	

## Wiring Connection

### Indoor unit


Wiring of the connecting cable can be carried out without removing the front panel.

1. Remove the air inlet grille.  
Open the air inlet grille upward and pull it toward you.
2. Remove the terminal cover and cord clamp.
3. Insert the connecting cable (according to the local cords) into the pipe hole on the wall.
4. Take out the connecting cable through the cable slot on the rear panel so that it protrudes about 20 cm from the front.
5. Insert the connecting cable fully into the terminal block and secure it tightly with screws.
6. Tightening torque : 1.2 N·m (0.12 kgf·m)
7. Secure the connecting cable with the cord clamp.
8. Fix the terminal cover, rear plate bushing and air inlet grille on the indoor unit.

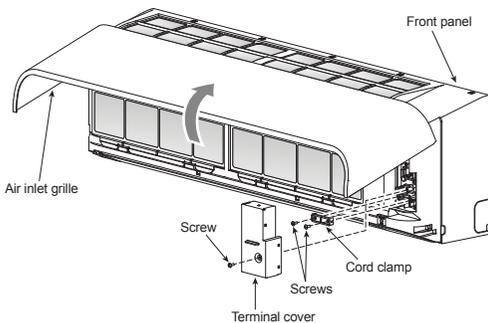



### Outdoor unit

1. Remove the valve cover, the electric parts cover and the cord clamp from the outdoor unit.
2. Connect the connecting cable to the terminal as identified by the matching numbers on the terminal block of indoor and outdoor unit.
3. Insert the power cord and the connecting cable carefully into the terminal block and secure it tightly with screws.
4. Use vinyl tape, etc. to insulate the cords which are not going to be used. Locate them so that they do not touch any electrical or metal parts.
5. Secure the power cord and the connecting cable with the cord clamp.
6. Attach the electric parts cover and the valve cover on the outdoor unit.

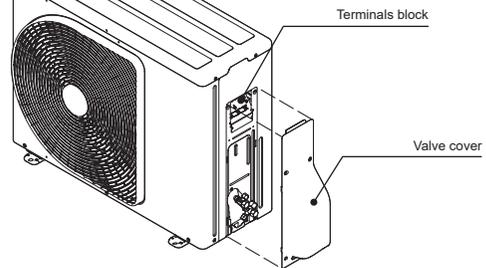


### How to install the air inlet grille on the indoor unit

- When attaching the air inlet grille, the contrary of the removed operation is performed.

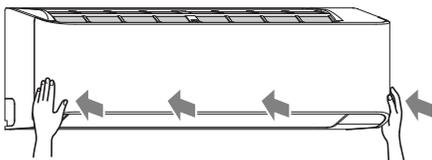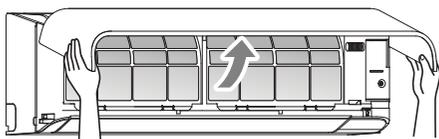

# Power Supply and Connecting Cable Connection

## Power Supply Input at Outdoor Unit Terminal Block

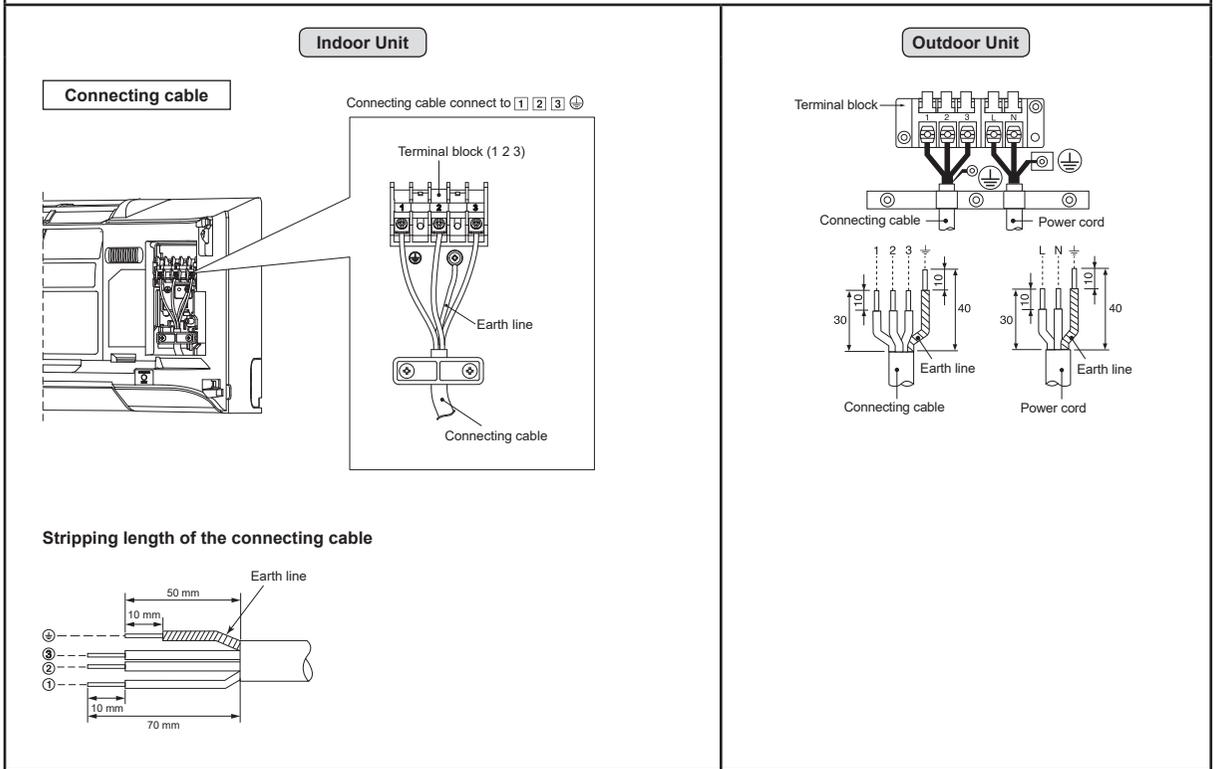


### CAUTION

1. The power supply must be same as the rated of air conditioner.
2. Prepare the power source for exclusive use with air conditioner.
3. Circuit breaker must be used for the power supply line of this air conditioner.
4. Be sure to comply power supply and connecting cable for size and wiring method.
5. Every wire must be connected firmly.
6. Perform wiring works so as to allow a general wiring capacity.
7. Wrong wiring connection may cause some electrical part burn out.
8. Incorrect or incomplete wiring is carried out, it will cause an ignition or smoke.
9. This product can be connected to main power supply.  
 Connection to fixed wiring : A switch which disconnects all poles and has a contact separation at least 3 mm must be incorporated in the fixed wiring.

# OTHERS

## Gas Leak Test

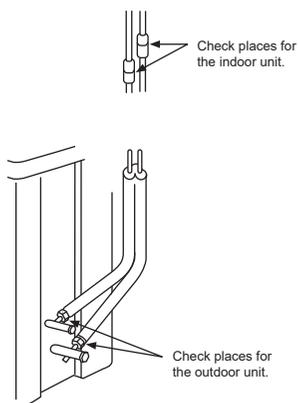

- Check the flare nut connections for the gas leak with a gas leak detector or soap water.

## Remote Control A-B Selection

- When two indoor units are installed in the same room or adjacent two rooms, if operating a unit, two units may receive the remote control signal simultaneously and operate. In this case, the operation can be preserved by setting either one remote control to B setting. (Both are set to A setting in factory shipment.)
- The remote control signal is not received when the settings of indoor unit and remote control are different.
- There is no relation between A setting/B setting and A room/B room when connecting the piping and cables.

To separate using of remote control for each indoor unit in case of 2 air conditioner are installed near.

### Remote Control B Setup.


1. Press [RESET] button on the indoor unit to turn the air conditioner ON.
2. Point the remote control at the indoor unit.
3. Push and hold [CHECK] button on the Remote Control by the tip of the pencil. "00" will be shown on the display (Picture ①).
4. Press [MODE] during pushing [CHECK]. "B" will show on the display and "00" will disappear and the air conditioner will turn OFF. The Remote Control B is memorized (Picture ②).

- Note :
1. Repeat above step to reset Remote Control to be A.
  2. Remote Control A have not "A" display.
  3. Default setting of Remote Control from factory is A.



## Test Operation

To switch the TEST RUN (COOL) mode, press [RESET] button for 10 seconds. (The beeper will make a short beep.)

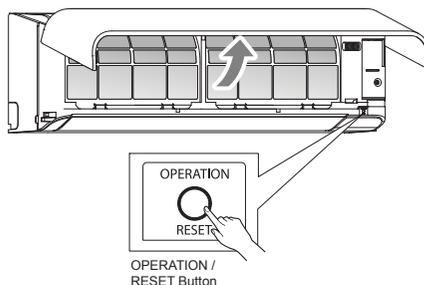

## Auto Restart Setting

This product is designed so that, after a power failure, it can restart automatically in the same operating mode as before the power failure.

### Information

The product was shipped with Auto Restart function in the OFF position. Turn it ON as required.

### How to set the Auto Restart

1. Press and hold the [RESET] button on the indoor unit for 3 seconds to set the operation. (3 beep sound and OPERATION lamp blink 5 time/sec for 5 seconds)
2. Press and hold the [RESET] button on the indoor unit for 3 seconds to cancel the operation. (3 beep sound but OPERATION lamp does not blink)
  - In case of ON timer or OFF timer are set, AUTO RESTART OPERATION does not activate.

# APPENDIX

## Work instructions

The existing R22 piping can be reused for inverter R410A product installations.



## WARNING

**Confirming the existence of scratches or dents on the existing pipes and confirming the reliability of the pipe strength are conventionally referred to the local site.**

**If the specified conditions can be cleared, it is possible to update existing R22 pipes to those for R410A models.**

## Basic conditions needed to reuse existing pipes

Check and observe the presence of three conditions in the refrigerant piping works.

1. **Dry** (There is no moisture inside of the pipes.)
2. **Clean** (There is no dust inside of the pipes.)
3. **Tight** (There are no refrigerant leaks.)

## Restrictions for use of existing pipes

**In the following cases, the existing pipes should not be reused as they are. Clean the existing pipes or exchange them with new pipes.**

1. When a scratch or dent is heavy, be sure to use new pipes for the refrigerant piping works.
2. When the existing pipe thickness is thinner than the specified "Pipe diameter and thickness," be sure to use new pipes for the refrigerant piping works.

- The operating pressure of R410A is high (1.6 times that of R22). If there is a scratch or dent on the pipe or a thinner pipe is used, the pressure strength may be inadequate, which may cause the pipe to break in the worst case.

## \* Pipe diameter and thickness (mm)

Pipe outer diameter	Ø6.4	Ø9.5	Ø12.7
Thickness	R410A 0.8	R22 0.8	0.8

3. When the outdoor unit was left with the pipes disconnected, or the gas leaked from the pipes and the pipes were not repaired and refilled.

- There is the possibility of rain water or air, including moisture, entering the pipe.

4. When refrigerant cannot be recovered using a refrigerant recovery unit.

- There is the possibility that a large quantity of dry oil or moisture remains inside the pipes.

5. When a commercially available dryer is attached to the existing pipes.

- There is the possibility that copper green rust has been generated.

6. When the existing air conditioner is removed after refrigerant has been recovered.

Check if the oil is judged to be clearly different from normal oil.

- The refrigerant oil is copper rust green in color.
- There is the possibility that moisture has mixed with the oil and rust has been generated inside the pipe.
- There is discolored oil, a large quantity of residue, or a bad smell.
- A large quantity of shiny metal dust or other wear residue can be seen in the refrigerant oil.

7. When the air conditioner has a history of the compressor failing and being replaced.

- When discolored oil, a large quantity of residue, shiny metal dust, or other wear residue or mixture of foreign matter is observed, trouble will occur.

8. When temporary installation and removal of the air conditioner are repeated such as when leased etc.

9. If the type of refrigerant oil of the existing air conditioner is other than the following oil (Mineral oil), Suniso, Freol-S, MS (Synthetic oil), alkyl benzene (HAB, Barrel-freeze), ester series, PVE only of other series.

- The winding-insulation of the compressor may deteriorate.

## NOTE


The above descriptions are results have been confirmed by our company and represent our views on our air conditioners, but do not guarantee the use of the existing pipes of air conditioners that have adopted R410A in other companies.

## Curing of pipes

When removing and opening the indoor or outdoor unit for a long time, cure the pipes as follows:

- Otherwise rust may be generated when moisture or foreign matter due to condensation enters the pipes.
- The rust cannot be removed by cleaning, and new pipes are necessary.

Placement location	Term	Curing manner
Outdoors	1 month or more	Pinching
Indoors	Less than 1 month	Pinching or taping
	Every time	

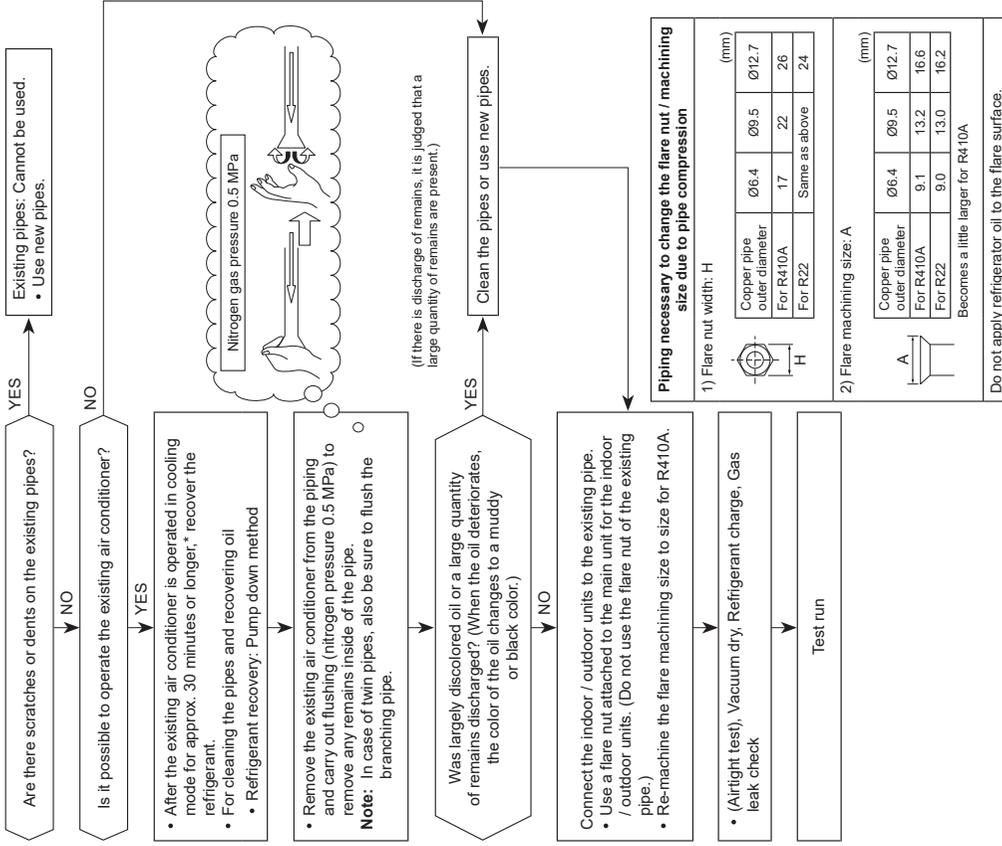

Do not apply refrigerant oil to the flare surface.

## ملحق

أنتيب حاليًا: لا يمكن استخدامها.

- تستخدم الأنتيب جديدة.

هل يوجد خدوش أو التبعات على الأنتيب الحالية؟

لا

هل من الممكن تشغيل مكيف الهواء الحالي؟

نعم

- بعد تشغيل مكيف الهواء على وضع التبريد (Cool) (لحالي)
- ٣٠ دقيقة أو أكثر. \*قم باستخدام سائل التبريد.
- للتطبيقات الأنتيب واستخدام الزيت
- استخدام سائل التبريد: طريقة الصنع المحلي.

• قم بزرع مكيف الهواء الحالي من الأنتيب وقد بإجراء التعطيل (ضعف التبريد) سائل التبريد ١٠٠ ميجا بالمل (إزالة أي بقايا داخل الأنتيب).

ملاحظة: في حال وجود أنبوبين مزودين، تأكد من تنظيف الأنتيب القديم.

هل يوجد تبريد كمية كبيرة من الزيت مغير اللون أو القاتم؟ (عندما يتلف الزيت، يتغير لونه إلى اللون المظلم أو الأسود)

لا

قم بتوصيل الوحدتين الداخلي/الخارجية في أنبوب التوصيل. استخدم صمامة: نتائج مرئية بالوحدة الرئيسية للوحدتين الداخلي/الخارجية. (لا تستخدم صمامة الفتح الخاصة بالأنتيب الحالي).

• قم بإعادة تهيئة مكيف آلة الفتح المناسب مكيف R410A.

• (اختيار) إكمال الإغلاق)، خفف مضخة الضغط تحتية سائل التبريد، فحص شرب الغاز

تطبيق الاختيار

الأنابيب الزرنية تغيير صمامة الفتح / مكيف لتسهيل نتيجة ضغط الأنتيب.

(م) عرض صمامة الفتح: H

القطر الخارجي Ø١٦٠,٤

القطر الداخلي Ø١٢٧

• عند ارتفاع مكيف مطح تجريب بالأنابيب الحالية.

• يوجد احتمال لتكون صدأ التماس الأخرس.

• عند إزالة مكيف الهواء الحالي بعد استرداد سائل التبريد.

• ق مما إذا كان الزيت مختلف بشكل واضح عن الزيت المعتاد.

• لأن زيت آلة التبريد أحمر نحاسي صقي؛

• يوجد احتمال لامتزاج الرطوبة بالرابت الأمر الذي أدى لتكون الصدأ داخل الأنتيب.

• عند زيت مغير اللون، أو كمية كبيرة من الشوائب، أو رائحة كريهة.

• كمية كبيرة من الغاز المحبى الأضغ أو شوائب أخرى يمكن رؤيتها في زيت آلة التبريد.

• عند وجود موانع السطح وحده المعالجة الخاصة بمكيف الهواء واستخدامها

• عندما يتواجد زيت مغير اللون، ومقادير كبير من الراسب أو صدأ معدني لأضغ، أو غير ها من رواسب الأمشلاك أو مزيج من المواد الغريبة، فإن تلك مؤثر على قرب حثرت

مكيفة.

• عند تكرار تركيب وإزالة مكيف الهواء بشكل متكرر، وذلك عند تكرار تاجير المكيف مثلا.

• في حال كان نوع زيت آلة التبريد المكيف الهواء الحالي مختلفا عن الزيت التالي (الزيت المعنى)، زيت Suniso أو Freols أو MS (الزيت الاصطناعي) أو الأكليل بيزين (HAB)، بربل فريزن (مسئلة الإمتزج، وال PVE فقط لمسئلة الإمتزج.

• قد يتلف ملف العزل الخاص بوحدة الكومبريسور.

ملاحظة

الأوصاف المذكورة أعلاه هي نتائج تم تأكيدها من قبل شركتنا وتمثل وجهة نظرينا في مكيفات الهواء الخاصة بآلة أكتنا لا تضمن استخدام الأنتيب الحالية لمكثفات الهواء الأخرى التي اصنعت سائل التبريد R410A في الشركات الأخرى.

معالجة الأنتيب

عند إزالة الوحدة الداخلية أو الخارجية وتجهيزها لمدة طويلة، قم بمعالجة الأنتيب كما يلي:

• قد يتكون الصدأ نتيجة دخول الرطوبة أو المواد الغريبة في الأنتيب.

• لا يمكن إزالة الصدأ بالتشطيب، وبالتالي يجب استخدام أنابيب جديدة.

عند ترك الوحدة الخارجية دون توصيل الأنتيب، أو عند شرب الغاز من الأنتيب دون إصلاحها أو إعادة تهيئها.

• يوجد احتمال لدخول مياه المطر أو الهواء أو الرطوبة إلى الأنتيب.

• في حال عدم إمكانية استرداد سائل التبريد بواسطة وحدة الأنتيب.

• عند عدم سائل التبريد.

• عند عدم إمكانية إعادة معالجة سائل التبريد أو الطريقة داخل الأنتيب.

تعليمات العمل

يمكن إعادة استخدام الأنتيب سائل التبريد R22 الموجودة للتبريد الخاصة بإجهزة سائل التبريد R410A انفرس.

### تحذير

يتم التأكد من وجود خدوش أو التبعات على الأنتيب الحالية والتأكد من موثوقية قوة الأنتيب في الموقع المحلي.

إذا أمكن تلبية الشروط المعطاة، فحينئذ يمكن استخدام الأنتيب سائل التبريد R22 الحالية وتجهيزها لتلائم مولدات سائل التبريد R410A.

الشروط الأساسية المطلوبة لإعادة استخدام الأنتيب الحالية

لا يجب إعادة استخدام الأنتيب الحالية في حال وجود أي من الحالات التالية، قم بتطبيقات الأنتيب الحالية أو استبدالها بأنتيب جديدة

١. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٢. في حال كان سلك الأنتيب الحالية أقل من "سلك وقطر الأنتيب" الخاصة بأنتيب سائل التبريد.

٣. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٤. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٥. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٦. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٧. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٨. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٩. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

١٠. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

١١. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

١٢. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

١٣. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

١٤. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

١٥. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

١٦. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

١٧. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

١٨. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

١٩. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٢٠. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٢١. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٢٢. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٢٣. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٢٤. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٢٥. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٢٦. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٢٧. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٢٨. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٢٩. عند وجود خدوش أو التبعات شديدة، تأكد من استخدام أنابيب جديدة خاصة بأنتيب سائل التبريد.

٣٠. عند ترك الوحدة الخارجية دون توصيل الأنتيب، أو عند شرب الغاز من الأنتيب دون إصلاحها أو إعادة تهيئها.

• يوجد احتمال لدخول مياه المطر أو الهواء أو الرطوبة إلى الأنتيب.

• في حال عدم إمكانية استرداد سائل التبريد بواسطة وحدة الأنتيب.

• عند عدم سائل التبريد.

• عند عدم إمكانية إعادة معالجة سائل التبريد أو الطريقة داخل الأنتيب.

• عند عدم سائل التبريد.

• عند عدم إمكانية إعادة معالجة سائل التبريد أو الطريقة داخل الأنتيب.

• عند عدم سائل التبريد.

• عند عدم إمكانية إعادة معالجة سائل التبريد أو الطريقة داخل الأنتيب.

• عند عدم سائل التبريد.

• عند عدم إمكانية إعادة معالجة سائل التبريد أو الطريقة داخل الأنتيب.

• عند عدم سائل التبريد.

• عند عدم إمكانية إعادة معالجة سائل التبريد أو الطريقة داخل الأنتيب.

• عند عدم سائل التبريد.

• عند عدم إمكانية إعادة معالجة سائل التبريد أو الطريقة داخل الأنتيب.


• عند عدم سائل التبريد.

• عند عدم إمكانية إعادة معالجة سائل التبريد أو الطريقة داخل الأنتيب.


## مواضيع أخرى

### اختبار التشغيل

لاختبار وضع التشغيل (تبريد) ، اضغط الزر [RESET] لمدة ١٠ ثوان. (سوف تصدر إشارة تنبيه صوتية قصيرة).

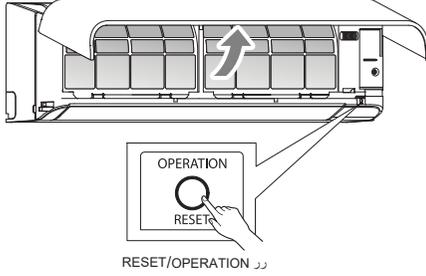

### اختبار تسرب الغاز



تحقق من توصيلات صامولة التفلج وذلك لاكتشاف تسرب الغاز عن طريق كاشف تسرب الغاز أو ماء الصابون.

### إعدادات إعادة التشغيل التلقائي

تم تصميم هذا الجهاز بحيث، يتم إعادة تشغيله تلقائيًا بعد انقطاع التيار الكهربائي، على نفس وضع التشغيل السابق لانقطاع التيار الكهربائي.

#### معلومات

تم شحن المنتج مع وظيفة إعادة التشغيل التلقائي في OFF (إيقاف) وضع الإيقاف. تشغيله على النحو ON (تشغيل) المرغوب فيه.

### كيفية ضبط إعادة التشغيل التلقائي


1. اضغط مع الاستمرار على الزر [RESET] في الوحدة الداخلية لمدة ٣ ثوان لضبط التشغيل. (سوف تصدر ٣ إشارات تنبيه صوتية وسيومض مصباح التشغيل ٥ مرات/ثوان لمدة ٥ ثوان)
2. اضغط مع الاستمرار على الزر [RESET] في الوحدة الداخلية لمدة ٣ ثوان لإلغاء التشغيل. (اضغط مع الاستمرار على الزر في الوحدة الداخلية لمدة ٣ ثوان لكن لن يومض مصباح التشغيل) • في حال ضبط المؤقت على الوضع ON (تشغيل) أو OFF (إيقاف)، فلن يتم تفعيل خاصية التشغيل التلقائي.

### الاختيار بين جهاز التحكم عن بعد على الإعداد A أو B

- في حال تركيب وحتنين داخليتين في نفس الغرفة أو في غرفتين متجاورتين، فقد تستقبل الوجدتان إشارة جهاز التحكم عن بعد في نفس الوقت عند التشغيل. وفي هذه الحالة يمكن ضبط التشغيل من خلال ضبط أحد جهازي التحكم على الإعداد B. (كلاهما مضبوط على الإعداد A بضبط المصنع.)
  - لا يتم استقبال إشارة جهاز التحكم عن بعد عند اختلاف إعدادات جهاز التحكم عن بعد والوحدة الداخلية.
  - لا يوجد علاقة بين الإعداد A/الإعداد B والغرفة A/الغرفة B عند توصيل الأنيبيب والأسلاك.
- لفصل استخدام جهاز التحكم عن بعد لكل وحدة داخلية في حال تثبيت جهازي مكيف هواء بالقرب من بعضهما البعض.

#### إعداد جهاز التحكم عن بعد على الوضع B


1. اضغط على الزر [RESET] (إعادة الضبط) في الوحدة الداخلية لتشغيل مكيف الهواء (ON).
  2. قم بتوجيه جهاز التحكم عن بعد ناحية الوحدة الداخلية.
  3. اضغط مع الاستمرار على الزر [CHECK] في جهاز التحكم عن بعد بواسطة سن قلم. وسوف يظهر "00" على شاشة العرض كما (الصورة ①).
  4. اضغط على الزر [MODE] مع الاستمرار بالضغط على الزر [CHECK]. سوف يظهر الحرف "B" على شاشة العرض، ويختفي الرمز "00"، ومن ثم يتم إيقاف تشغيل مكيف الهواء OFF. وبذلك يتم حفظ إعداد جهاز التحكم B (الصورة ②).
- ملحوظة: 1. كرر الخطوة السابقة لإعادة ضبط جهاز التحكم عن بعد على الإعداد A.  
2. لا يشمل إعداد جهاز التحكم A على شاشة العرض التي تظهر الحرف "A".  
3. ضبط المصنع الافتراضي لجهاز التحكم عن بعد هو A.

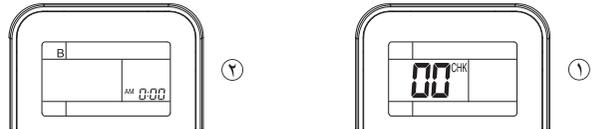

## توصيل مزود الطاقة وكابل التوصيل


### مدخل مزود الطاقة في الهيكل الصندوقي للوحدة الخارجية

#### الوحدة الخارجية

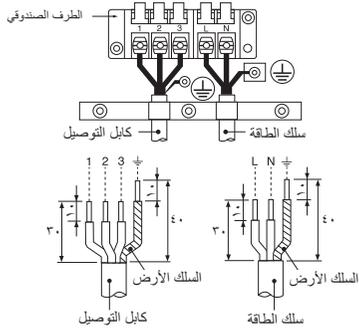


#### الوحدة الداخلية

#### كابل التوصيل

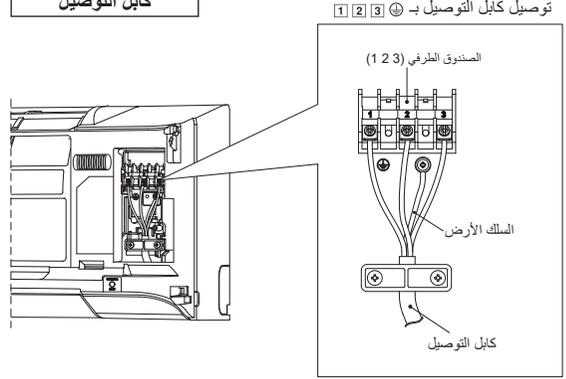

#### طول تعرية كابل التوصيل



#### تنبيه

1. يجب أن يكون مزود الطاقة هو نفسه المصنّف لمكيف الهواء.
  2. قم بتجهيز مصدر الطاقة للاستخدام مع المكيف فقط دون أجهزة أخرى.
  3. يجب استخدام قاطع الدائرة الكهربائية على خط مزود الطاقة الخاص بمكيف الهواء.
  4. تأكد من توافق مزود الطاقة وكابل التوصيل من ناحية الحجم وطريقة توصيل الأسلاك.
  5. يجب توصيل كل سلك بإحكام.
  6. قم بتنفيذ أعمال توصيل الأسلاك لتوفير قدرة للأسلاك العامة.
  7. قد يؤدي التوصيل الخاطئ للأسلاك إلى احتراق بعض الأجزاء الكهربائية.
  8. في حال التوصيل الخاطئ أو غير المكتمل للأسلاك، يمكن أن يؤدي ذلك إلى حدوث اشتعال أو دخان.
  9. يمكن توصيل هذا الجهاز بالمصدر الرئيسي للطاقة.
- التوصيل بالأسلاك الثابتة: يجب تضمين مفتاح يفصل كافة الأقطاب ويشتمل على فاصل تماس 3 مم على الأقل في الأسلاك الثابتة.

## الأعمال الكهربائية

الطراز	18k	24k
مصدر الطاقة	٢٢٠-٢٤٠ فولت ، ٥٠ هرتز مرحلة واحدة	
الحد الأقصى للتيار	A ٨,٩٠	A ١١,٤٠
قدرة قاطع الدائرة الكهربائية	A ١١,٠	A ١٤,٠
كابل مزود الطاقة	H07RN-F أو IEC66 60245 (٢,٥ مم ٢ أو أكثر)	
كابل التوصيل	H07RN-F أو IEC66 60245 (١,٥ مم ٢ أو أكثر)	

### توصيل الأسلاك



#### الوحدة الداخلية

يمكن القيام بتوصيل أسلاك كابل التوصيل دون إزالة اللوحة الامامية.

١. انزع شبكة مدخل الهواء.
٢. افتح شبكة مدخل الهواء للأعلى ثم قم بجذبها نحوك.
٣. انزع غطاء الطرف الصندوقي ومشبك السلك.
٤. قم بإدخال كابل التوصيل (وفقاً لنظام الأسلاك المحلي) في فتحة الأنبوب في الحائط.
٥. قم بإخراج كابل التوصيل عبر فتحة الكابل في اللوحة الخلفية حتى تبرز حوالي ٢٠ سم من الأمام.
٦. قم بإدخال كابل التوصيل بالكامل في الجزء الطرفي وقم بتثبيتته بإحكام بواسطة المسامير.
٧. مقدار عزم الربط: ١,٢ نيوتن متر (٠,١٢ كيلوجرام ثقلي.متر).
٨. قم بتثبيت كابل التوصيل بإحكام بواسطة مشبك السلك.
٩. قم بتثبيت الغطاء الطرفي، والبطانة المعدنية للوحة الخلفية، وشبكة مدخل الهواء في الوحدة الداخلية.



#### الوحدة الخارجية

١. انزع غطاء الصمام، وغطاء الأجزاء الكهربائية، ومشبك الأسلاك من الوحدة الخارجية.
٢. قم بتوصيل كابل التوصيل بالطرف الصندوقي كما هو محدد عن طريق مطابقة الأرقام على هيكل الوحدتين الداخلية والخارجية.
٣. قم بإدخال سلك الطاقة وكابل التوصيل بعناية في الجهاز الطرفي وثبته بإحكام بواسطة المسامير.
٤. استخدم شريط الفينيل، غيره لعزل الأسلاك التي لن تستخدمها. حدد أماكن تلك الأسلاك بحيث لا تلامس أي أجزاء كهربائية أو معدنية.
٥. قم بتثبيت سلك الطاقة وكابل التوصيل بواسطة مشبك الأسلاك.
٦. قم بتثبيت غطاء الأجزاء الكهربائية وغطاء الصمام على الوحدة الخارجية.

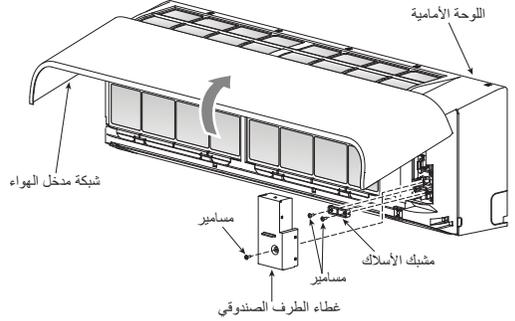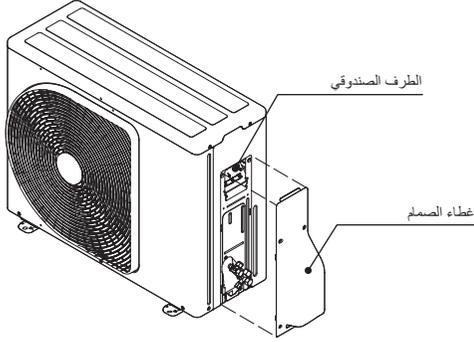

#### طريقة تثبيت شبكة مدخل الهواء في الوحدة الداخلية

• عند تثبيت شبكة مدخل الهواء، قم بتنفيذ عكس عملية النزاع.

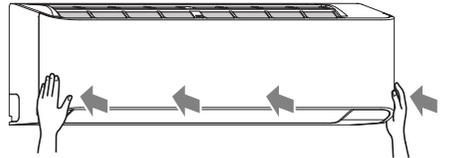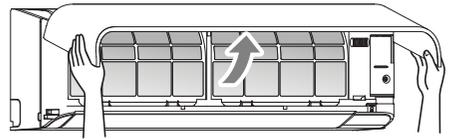


• افتح الصمام للخارج، لكن لا تحاول فتح أبعد من السدادة.

مقاس مفتاح الربط السداسي	مقاس الأنبوب للصمام المركب
م = ٤ مم	١٢,٧٠ مم والأصغر منها
م = ٥ مم	١٥,٨٨ مم

• قم بإحكام ربط غطاء الصمام بشكل آمن مستخدماً العزم الموضح بالجدول التالي :

عزم الربط	مقاس الغطاء (H)	الغطاء
١٨ ~ ١٤ نيوتن متر (١,٤٤ إلى ١,٨ كيلوجرام ثقلي.م)	H١٩ - H١٧	غطاء قضيب الصمام
٤٢ ~ ٣٣ نيوتن متر (٣,٣ إلى ٤,٢ كيلوجرام ثقلي.م)	H٣٠ - H٢٢	
١٢ ~ ٨ نيوتن متر (٠,٨ إلى ١,٢ كيلوجرام ثقلي.م)	H١٤	غطاء منفذ الخدمة
١٨ ~ ١٤ نيوتن متر (١,٤ إلى ١,٨ كيلوجرام ثقلي.م)	H١٧	

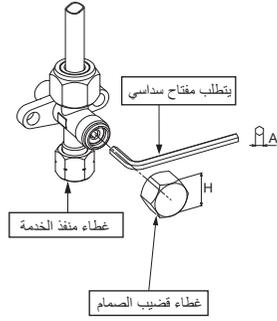

## توصيل أنابيب سائل التبريد

### تفليج الأنابيب

١. أقطع الأنابيب باستخدام قاطع الأنابيب.




٢. أدخل صامولة التفليج في الأنابيب وقم بتفليج الأنابيب.  
• هامش التتوء في التفليج : A (الوحدة : مم)

RIDGID (من نوع جهاز التشبيك)

القطر الخارجي للأنبوب النحاسي	عند استخدام أداة R410A	عند استخدام أداة تقليدية
Ø 6,35	٠ إلى ٠,٥	١,٥ إلى ١,٥
Ø 9,52	٠ إلى ٠,٥	١,٥ إلى ١,٥
Ø 12,70	٠ إلى ٠,٥	١,٥ إلى ١,٥
Ø 15,88	٠ إلى ٠,٥	١,٥ إلى ١,٥
سمك الأنابيب	٠,٨ مم أو أكثر	

IMPERIAL (نوع الصامولة المجنحة)

القطر الخارجي للأنبوب النحاسي	R410A
Ø 6,35	١,٥ إلى ٢,٥
Ø 9,52	١,٥ إلى ٢,٥
Ø 12,70	٢,٥ إلى ٢,٥
Ø 15,88	٢,٥ إلى ٢,٥
سمك الأنابيب	٠,٨ مم أو أكثر




### تنبيه

- لا تحدش السطح الداخلي للجزء المفلاج عند إزالة الحواف المشوهة.
- عند معالجة التفليج في حالة الخدوش بالسطح الداخلي لجزء معالجة التفليج، سيؤدي ذلك إلى تسرب غاز التبريد.

### إحكام التوصيل

قم بمحاذاة مراكز أنابيب التوصيل ثم أحكم ربط صامولة التفليج بأقصى ما يمكنك باستخدام أصابعك. بعد ذلك أحكم ربط الصامولة باستخدام مفتاح ربط ومفتاح عزم كما هو موضح بالصورة.

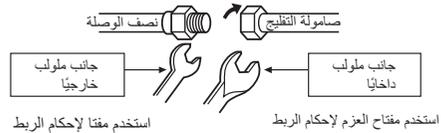

### تنبيه


لا تستخدم عزمًا زائدًا، وإلا فقد تنكسر الصامولة حسب الحالة.

(الوحدة : نيوتن متر)

عزم الربط	القطر الخارجي للأنبوب النحاسي
١٦ إلى ١٨ (١,٦ إلى ١,٨ كيلوجرام ثقلي)	Ø 6,35 مم
٤٦ إلى ٣٠ (٣,٠ إلى ٤,٢ كيلوجرام ثقلي)	Ø 9,52 مم
٥٠ إلى ٦٢ (٥,٠ إلى ٦,٢ كيلوجرام ثقلي)	Ø 12,70 مم
٦٥ إلى ٨٠ (٦,٥ إلى ٨,٠ كيلوجرام ثقلي)	Ø 15,88 مم

• إحكام عزم صامولة توصيلات الأنابيب

ضغط التشغيل لسائل التبريد R410A أعلى من سائل التبريد R22 (بمقدار ١,٦ مرة تقريبًا). ولذلك فمن الضروري أن تربط الأجزاء الموصلة لأنبوب التفليج بإحكام (التي تصل بين الوحدتين الداخلية والخارجية) حتى تصل إلى عزم الإحكام المحدد. قد تسبب التوصيلات غير الصحيحة في تسرب الغاز، كما قد تلحق أيضًا أضرارًا بدورة التبريد.



## التفريغ

يعد توصيل الأنابيب بالوحدة الداخلية، يمكنك القيام بطرد الهواء معًا في آن واحد.


### طرد الهواء

قم بتفريغ الهواء من أنابيب التوصيل والوحدة الداخلية باستخدام مضخة تفريغ. لا تستخدم سائل التفريغ في الوحدة الخارجية. لمزيد من التفاصيل، انظر دليل مضخة التفريغ.

## استخدام مضخة التفريغ

تأكد من استخدام مضخة تفريغ تشتمل على وظيفة منع التدفق العكسي حتى لا يتدفق الزيت الموجود بالمضخة عكسيًا ويعود إلى داخل أنابيب مكيف الهواء عند توقف المضخة. (في حال دخول الزيت الموجود بمضخة التفريغ إلى مكيف الهواء الذي يستخدم سائل التبريد R410A، فقد تحدث مشاكل في دورة التبريد.)

١. قم بتوصيل خرطوم الشحن من الصمام متشعب المسالك بمنفذ خدمة الصمام الموجود في جهة الغاز.
٢. قم بتوصيل خرطوم الشحن بمنفذ مضخة التفريغ.
٣. افتح مقبض جانب الضغط المنخفض الخاص بالصمام متشعب المسالك بشكل كامل.
٤. قم بتشغيل مضخة التفريغ لبدء التفريغ. واصل التفريغ لمدة ١٥ دقيقة تقريبًا إذا كان طول الأنابيب ٢٠ مترًا (١٥ دقيقة لكل ٢٠ مترًا) (بافتراض أن سعة المضخة هي ٢٧ لترًا في الدقيقة). ثم تحقق من أن قراءة مقياس الضغط المركب هي ١٠١ كيلو باسكال (-٧٦ سم زئبقي).
٥. أغلق مقبض صمام جانب الضغط المنخفض الخاص بالصمام متشعب المسالك للمقياس.
٦. افتح ساق الصمام الخاص بالصمامات المركبة بشكل كامل (لجانب الغاز والسائل).
٧. قم بإخراج خرطوم الشحن من منفذ الخدمة.
٨. قم بربط أغطية الصمامات المركبة بإحكام.

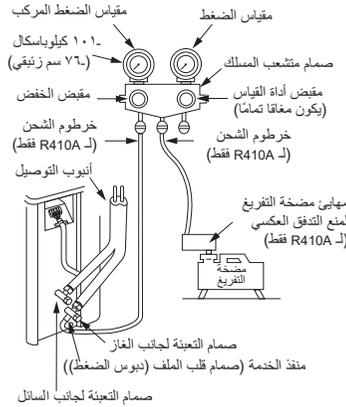


### تنبيه

• حافظ على ٦ نقاط مهمة خاصة بأعمال الأنابيب.


- (١) ازل الأوساخ والرطوبة (في داخل أنابيب التوصيل).
- (٢) أحكم شد التوصيل (بين الأنابيب والوحدة).
- (٣) قم بتفريغ الهواء الموجود في أنابيب التوصيل باستخدام مضخة تفريغ.
- (٤) افحص تسرب الغاز (نقاط التوصيل).
- (٥) لا بد من التأكد من أن الصمامات مفتوحة تمامًا قبل بدء التشغيل.
- (٦) لا يُسمح بالوصلات المفلجة والوصلات الميكانيكية القابلة لإعادة استخدام في الداخل. عند إعادة استخدام الموصلات الميكانيكية في الداخل، يجب تجديد الأجزاء المانعة للتسرب عند إعادة استخدام الموصلات المفلجة في الداخل، يجب إعادة تصنيع الجزء المفلاج.

- ضع الماء في حوض التصريف وتأكد أنه يتصرف من الفتحات.
- عند توصيل خرطوم التصريف الإضافي، قم بعزل جزء التوصيل من خرطوم التصريف الإضافي بالأنيوب الواقي.



### تنبيه

قم بتعديل أنيوب التصريف من أجل التصريف الجيد من الوحدة. قد يؤدي التصريف الخاطئ إلى تساقط الماء في صورة طرات ندى.




يتمتع مكيف الهواء هذا بهيكل مُصمَّم خصيصاً لتصريف الماء المجمع من قطرات الندى التي تتشكل على الجزء الخلفي من الوحدة الداخلية في وعاء التصريف. ولذا، لا تقم بتخزين سلك الطاقة أو أي أجزاء أخرى في مستوى الطاعة من مجرى التصريف.

## التصريف

- اجعل خرطوم التصريف منحدرًا للأسفل.

### ملاحظة

- يجب عمل الفتحة بميلان طفيف نحو الأسفل من الجهة الخارجية.

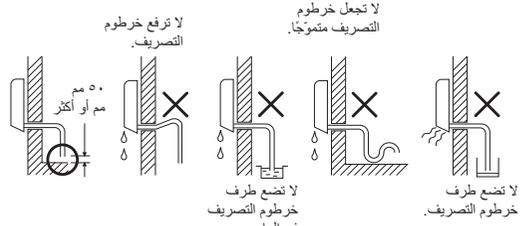

## الوحدة الخارجية

### تصريف المياه

- توجد فتحات على اللوح القاعدي للوحدة الخارجية للتأكد من أن المياه المذابة الناتجة أثناء عمليات التدفئة يتم تصريفها بكفاءة.
- إذا كانت هناك حاجة إلى تصريف مركزي عند تركيب الوحدة في شرفة أو على الحائط، فاتباع الخطوات التالية أثناء تصريف المياه.


- ابدأ بمنع تسرب المياه عن طريق تركيب الأغشية المطاطية الخاصة بمنع تسرب المياه في الفتحتين الممدودتين على طول اللوح القاعدي للوحدة الخارجية.

[كيفية تركيب الأغشية المطاطية الخاصة بمنع تسرب المياه]

- ضع أربعة أصابع في كل غطاء، ثم أدخل الأغشية في فتحات تصريف المياه عن طريق الضغط عليها وإدخالها في مكانها من الجانب السفلي للوح القاعدي.

- اضغط للأسفل على المحيط الخارجي للأغشية من جميع الجوانب للتأكد من أنها قد أدخلت بشكل مُحكم.


(قد يحدث تسرب للمياه إن لم يتم تركيب الأغشية بشكل صحيح، أو إن كان المحيط الخارجي للأغشية مرفوعًا، أو إذا عُلقت أو خُشرت الأغشية في شيء ما.)

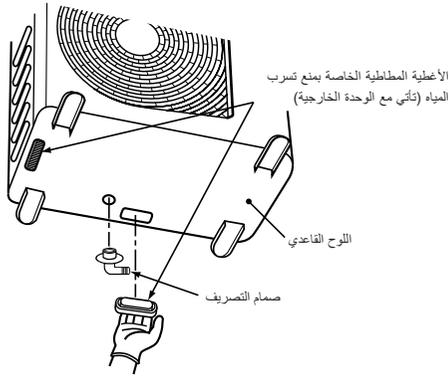

- قم بتركيب صمام التصريف وخرطوم التصريف المتاح بالأسواق (بقطر داخلي ١٤ مم)، وقم بتصريف المياه.

(بالنسبة للموضع الذي يتم فيه تركيب صمام التصريف، ارجع إلى مخطط التثبيت الخاص بالوحدات الداخلية والخارجية.)

- تأكد من أن الوحدة الخارجية مثبتة بشكل أفقي، وقم بتوجيه خرطوم التصريف باتجاه زاوية منحدرًا للأسفل مع التأكد من توصيله بإحكام.

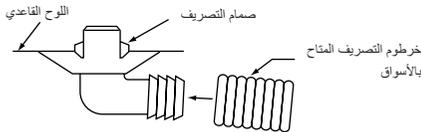

لا تستخدم خرطوم الحديقة العادي، لكن استخدم خرطومًا مرنا ويمكن جعله مسطحًا ويمنع المياه من التسرب.

### مكان التركيب

- مكان يوفر مساحة كافية حول الوحدة الخارجية كما هو موضح بالمخطط.
- مكان يمكنه تحمل وزن الوحدة الخارجية ولا يتسبب في زيادة مستوى الضوضاء والاهتزاز.
- مكان لا يتسبب في إزعاج الجيران نتيجة الضوضاء والهواء المفرغ.
- مكان غير معرض لرياح شديدة.
- مكان خالٍ من أي تسرب للغازات القابلة للاشتعال.
- مكان لا يعترض الطريق.
- في حال تركيب الوحدة الخارجية في مكان مرتفع، تأكد من تأمين قاعدتها.
- الطول المسموح به لأنبوب التوصيل.

الطرز	18k	24k
غير معبأ	يصل إلى ١٥ م	يصل إلى ١٥ م
الحد الأقصى للطول	٢٠ م	٢٥ م
تعينة إضافية لسائل التبريد	١٦ متر (٢٠ ج / ١ م)	١٦ - ٢٥ متر (٣٠ ج / ١ م)
تعينة الأقصى لسائل التبريد	١,٥٥ كلف	٢,٢٠ كلف

- الارتفاع المسموح به لموقع تركيب الوحدة الخارجية.

الطرز	18k	24k
الحد الأقصى للطول	١٥ م	١٥ م

- مكان لا يسبب فيه ماء التصريف أي مشاكل.

### الاحتياطات عند إضافة سائل التبريد


- استخدم مقياسًا بدقة لا تقل عن ١٠ جم لكل خط من خطوط المؤشر عند إضافة سائل التبريد.
- لا تستخدم مقياس الحمام أو أي أداة مشابهة.

### تنبيه

- عند تركيب الوحدة في الخارج في مكان قد تسبب فيه مياه التصريف أي مشكلات، أحكم سد نقطة تسرب المياه باستخدام مادة لاصقة من السيليكون أو مركب سد وتغليف.

### تنبيه

- لا يتم تثبيت الوحدة الخارجية في مكان لا يوجد به ما يعيق تفرغ الهواء.
- عند تركيب الوحدة الخارجية في مكان معرض دائمًا لرياح قوية مثل الساحل أو طابق مرتفع من أحد المباني، احرص على تأمين تشغيل المروحة العادية باستخدام مجرى أو واق من الرياح.
- في المناطق شديدة الرياح على وجه الخصوص، قم بتثبيت الوحدة الخارجية بشكل يمنع دخول الرياح.
- قد يؤدي تثبيت الوحدة في هذه الأماكن إلى حدوث مشاكل؛ لذا لا تقم بتثبيتها هناك.




- فلا تركب الوحدة في تلك الأماكن.
- مكان مليء بزيت الآلات
- مكان مليء بالمواد السائلة
- مكان مليء بغاز الكبريتيد
- مكان من المحتمل أن تتولد فيه موجات عالية التردد كالتي تصدر من أجهزة الصوت وأدوات اللحام، والمعدات الطبية

## ملاحظة

إذا تم ثني الأنبوب بشكل غير صحيح، فقد تصبح الوحدة الداخلية غير مستقرة على الجدار. وبعد تمرير أنبوب التوصيل عبر فتحة الأنبوب، قم بتوصيل أنابيب التوصيل بالأنابيب الإضافية المساعدة ثم قم بلفها باستخدام شريط عازل.

## تنبيه



- اربط الأنبوبين المساعدةين و (اثنين) كابل التوصيل بشريط عازل بإحكام. في حال الأنابيب المتجهة لليساار أو اليسار الخلفي، اربط الأنبوبين الممس (اثنين) فقط بشريط عازل.

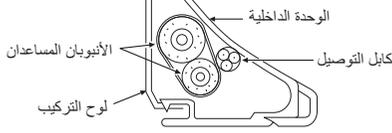


- رتب الأنابيب بحرص بحيث لا يبرز أي أنبوب من اللوحة الخلفية للوحدة الداخلية.
- قم بتوصيل الأنبوبين المساعدةين وأنابيب التوصيل بعناية وقص الشريط العازل المملوف حول أنبوب التوصيل لتجنب تلف المزدوج عند المفصل، ثم قم بتغليف المفصل بشريط من الفينيل، وغيره.
- احرص على عزل أنبوبي التوصيل كليهما لأن الندى يسبب مشكلة ميكانيكية. (استخدم رغوة البوليثلين كمادة عازلة).
- قم بثني الأنبوب بحرص حتى لا يتكسر أثناء فعل ذلك.

## تثبيت الوحدة الداخلية

1. أدخل الأنبوب في الفتحة الموجودة بالجدار ثم قم بتثبيت الوحدة الداخلية بلوح التركيب عند الكلاب العلوي.
2. قم بهز الوحدة الداخلية إلى اليمين واليسار للتأكد من أنها مثبتة بإحكام في لوح التركيب.
3. أثناء الضغط على الوحدة الداخلية على الجدار، قم بتثبيتها في الجزء السفلي من لوح التركيب. اسحب الوحدة الداخلية نحوك للتأكد من أنها مثبتة بإحكام في لوح التركيب.

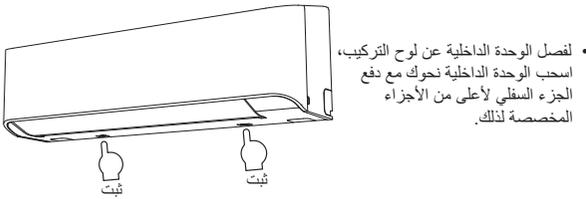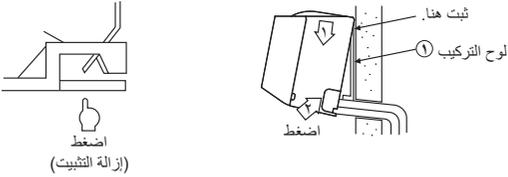

## تمهله



قد يطفو الجزء السفلي من الوحدة الداخلية بسبب حالة تركيب الأنابيب وقد لا تتمكن من تثبيتها في لوح التركيب. وفي هذه الحالة، استخدم المسامير (١٠) لتثبيت الوحدة ولوح التركيب.


## كيفية نزع خرطوم التصريف

- يمكن نزع خرطوم تصريف الماء بواسطة نزع المسامير الذي يثبت خرطوم التصريف ومن ثم نزعه إلى الخارج.
- عند نزع خرطوم التصريف، انتبه للحواف الحادة لوح المعدني. فقد تسبب تلك الحواف جروحاً.
- لتثبيت خرطوم التصريف، قم بإدخال خرطوم التصريف بإحكام حتى يلامس جزء التوصيل العازل الحراري، ثم قم بتثبيته بمسمار أصلي.




## كيفية إزالة غطاء التصريف

اشبك غطاء التصريف باستخدام زردية حادة المنقار واسحب.



## كيفية تثبيت غطاء التصريف


1. أدخل مفتاح ربط سداسي الرأس (٤ مم) في الرأس المركزي.
2. قم بإدخال غطاء التصريف بإحكام.

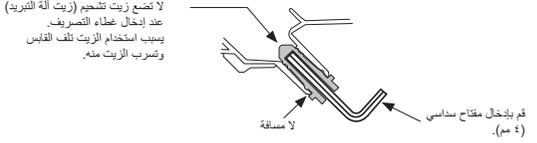


## تنبيه

أدخل خرطوم التصريف وغطاء التصريف بإحكام، وإلا قد يتسرب الزيت منه.

## في حال وجود الأنابيب في الناحية اليمنى أو اليسرى

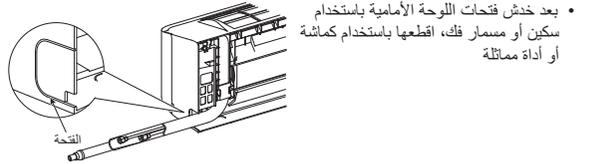


## في حال وجود الأنابيب أسفل الناحية اليمنى أو اليسرى

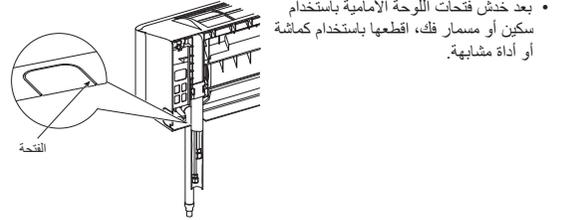

## توصيل الجانب الأيسر بالأنابيب


- قم بثني أنبوب التوصيل بحيث يكون على ارتفاع ٤٣ مم فوق سطح جدار. وإذا كان أنبوب التوصيل موجوداً على مسافة تزيد عن ٤٣ مم فوق سطح الجدار، فقد تصبح الوحدة الداخلية غير مستقرة على الجدار.

قم بثني أنبوب التوصيل بحيث يكون نصف قطره ٣٠ مم. لتوصيل الأنبوب بعد تركيب الوحدة (الشكل)

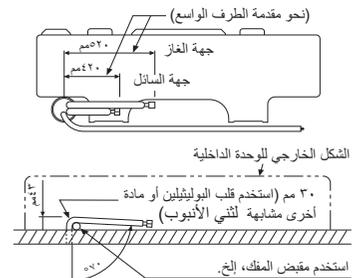




# مخطط تركيب الوحدات الداخلية والخارجية

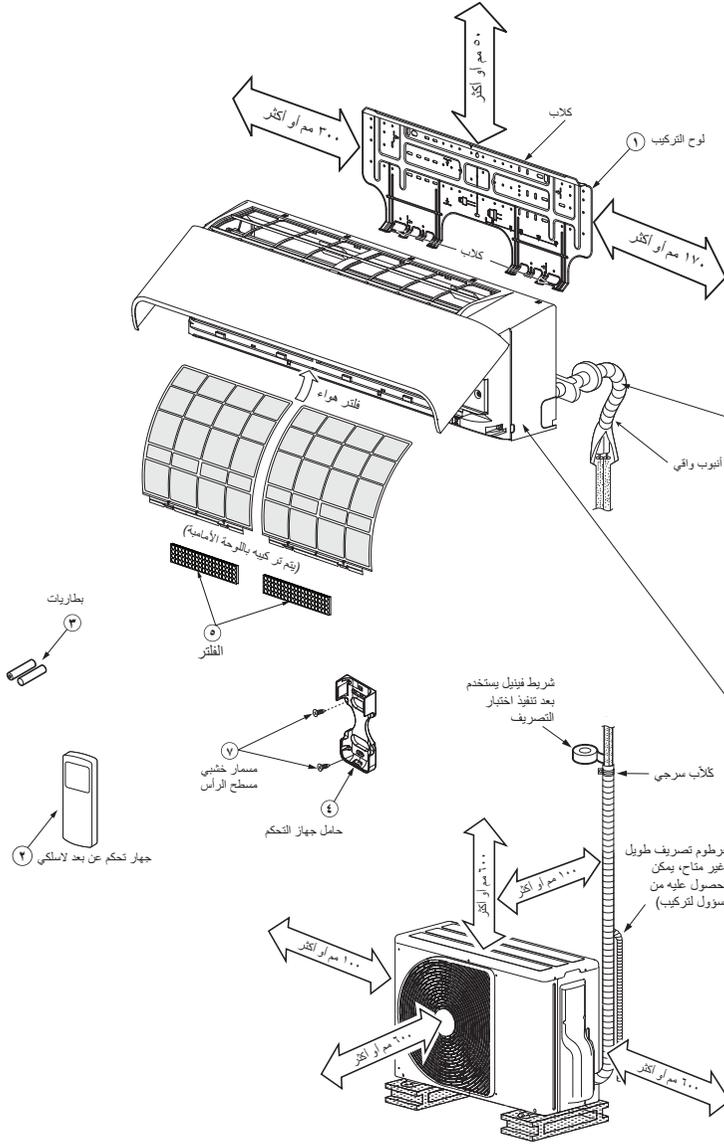


للأبواب الخلفية اليسرى، والسفلية اليسرى، واليسرى،

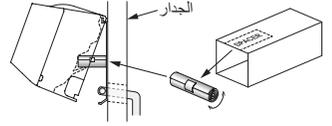


أقطع قطعة من العازل من صندوق تعبئة الوحدة الداخلية، وقم بلفه وإدراجه بين الوحدة الداخلية والجدار حتى تملأ الوحدة الداخلية للحصول على أفضل تشغيل.

لا تدع خرطوم التصريف يرتخي




تاكد من أن خرطوم التصريف منحدر للأسفل.

يمكن توصيل الأنابيب الإضافي إلى اليسار، أو اليسار الخلفي، أو اليمين الخلفي، أو اليمين السفلي، أو اليسار السفلي.




قم بعزل أنابيب سائل التبريد بشكل منفصل وليس معاً.




رغوة بولييثيلين مقاومة للحرارة بسمك 8 مم

## تثبيت نظام مسامير للوحدة الخارجية

- قم بإحكام تثبيت الوحدة الخارجية بمسامير التثبيت والصمولات إذا كان ض المحتمل تعرضها لرياح قوية.
- استخدم مسامير وصمولات التثبيت بمقاس 8 مم أو 10 مم.
- إن كان من الضروري تصريف المياه المذابة، قم بوصل صمام التصريف (11) وغطاء منع تسرب المياه (12) إلى اللوح السفلي للوحدة الخارجية قبل التثبيت



24k ل



18k ل

## قطع التركيب الاختيارية

رمز القطعة	اسم القطعة	الكمية
A	أنبوب التبريد جهة السائل : Ø6,35 مم جهة الغاز : Ø12,70 مم (ل 18k) جهة الغاز : Ø15,88 مم (ل 24k)	واحد لكل
B	مادة عزل الأنبوب (رغوة بولييثيلين بسمك 8 مم)	1
C	معجون ، شرائط PVC	واحد لكل

## القطع الملحقة

الوحدة الداخلية			
الرقم	اسم القطعة	الرقم	اسم القطعة
①	لوحة التركيب ١ × ١	②	جهاز التحكم عن بعد اللاسلكي ١ × ١
③	البطاريات ٢ × ٢	④	حامل جهاز التحكم عن بعد ١ × ١
⑤	فلتر توشيبا جديد ٢ × IAQ	⑥	مسامير التثبيت ٦ × ٦
⑦	مسامير خشبية مسطحة الرأس ٢ × ٢	⑧	دليل المالك ١ × ١
⑨	دليل التركيب ١ × ١	⑩	مسامير ٢ × ٢

الوحدة الخارجية			
الرقم	اسم القطعة	الرقم	اسم القطعة
⑪	استنزاف الحلمة ١ × ١	⑫	كاب المياه دليلًا ٢ × ٢

### فلتر الهواء

قم بتنظيفها كل أسبوعين.

١. افتح شبكة مدخل الهواء.

٢. قم بإزالة فلتر الهواء.

٣. قم بتنظيفها بالمكنسة الكهربائية أو غسلها بالماء وتجفيفها.

٤. أعد تركيب فلتر الهواء وقم بإغلاق شبكة مدخل الهواء.

### الفلتر

الصيانة والعمر الافتراضي

قم بتنظيفه كل ٦-٣ أشهر عندما يتجمع الغبار على الفلتر أو يغطيه.


١. ننصح باستخدام المكنسة الكهربائية لشطف الغبار والأتربة العالقة أو المتجمعة في الفلتر، أو استخدام المنفاخ لفتح التراب وإخراجه من الفلتر.

٢. عند الحاجة لاستخدام الماء في التنظيف، قم باستخدام الماء العادي لغسل الفلتر، وقم بتجفيفه تحت أشعة الشمس لمدة ٤-٣ ساعات أو إلى أن يجف تمامًا.

وإلا، قم باستخدام مجفف الشعر لتجفيفه. ومع ذلك، فإن استخدام الماء لتنظيف الفلتر قد يتسبب بتقليل أداء الفلتر.

٣. قم بتبديله كل عامين أو أقل. (اتصل بالموزع الخاص بك لشراء فلتر جديد) (P/N : RB-A620DE)

ملاحظة: يعتمد عمر الفلتر على مستوى الشوائب في بيئة التشغيل. قد تتطلب المستويات المرتفعة من الشوائب تنظيفًا أكثر واستبدالًا متكررًا. وفي جميع الأحوال، ننصح بمجموعة إضافية من الفلاتر لتحسين أداء التنقية وإزالة الروائح من مكيف الهواء.

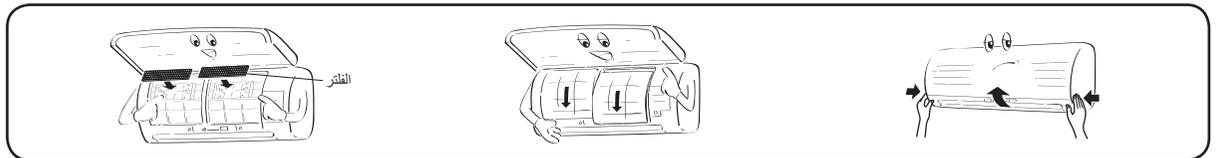

- قد يؤدي تعريض الوحدة للماء أو أي نوع من أنواع الرطوبة قبل التركيب إلى حدوث صدمة كهربائية. لا تقم بتخزينها في قبو رطب ولا تعرضها للمطر أو الماء.
- بعد فك الوحدة من التغليف، افحصها جيدًا للتأكد من عدم وجود تلف محتمل.
- لا تقم بالتركيب في مكان قد يزيد من اهتزاز الوحدة. ولا تقم بالتركيب في مكان قد يؤدي إلى تضخيم مستوى الضوضاء الصادرة عن الوحدة أو في مكان قد يزعج الجيران بسبب الضوضاء أو الهواء المفرغ الناجم عن الوحدة.
- كن حذرًا عند التعامل مع الأجزاء ذات الأطراف الحادة وذلك لتجنب الإصابات الشخصية.
- يرجى قراءة دليل التركيب هذا بعناية قبل القيام بتركيب الوحدة؛ فهو يحتوي على تعليمات هامة خاصة بكيفية التركيب الصحيحة.
- لا تتحمل الشركة المصنعة أي مسؤولية عن الضرر الناجم عن عدم الالتزام بالشرح الموجود بهذا الدليل.

### ضرورة إبلاغ موفر الطاقة الكهربائية المحلي

يرجى التأكد تمامًا من إبلاغ موفر الطاقة الكهربائية المحلي بتركيب هذا الجهاز قبل القيام بالتركيب. إن واجهتك أي مشكلة أو إن لم يوافق موفر الطاقة على التركيب، فسوف تتخذ الشركة التدابير المضادة المناسبة.

يجب توصيل هذا الجهاز بمزود الطاقة الرئيسي عن طريق قاطع تيار كهربائي أو مفتاح بفاصل تماس كهربائي قدره ٣ مم على الأقل في كافة الأقطاب.

## خطر

- للاستعمال بواسطة الأشخاص المؤهلين فقط.
- قم بإغلاق مزود الطاقة الرئيسي قبل محاولة القيام بأي أعمال كهربائية. تأكد من إغلاق جميع مفاتيح الطاقة.
- قد يؤدي التقصير في القيام بذلك إلى حدوث صدمة كهربائية.
- قم بتوصيل كابل التوصيل بطريقة صحيحة. قد يتسبب توصيل كابل التوصيل بطريقة خاطئة في تلف الأجزاء الكهربائية.
- افحص السلك الأرضي قبل التركيب وتأكد من عدم انقطاعه أو عدم توصيله.
- لا تقم بالتركيب بالقرب من تجمعات الغازات القابلة للاشتعال أو أبخرة الغازات. لا تقم بالتركيب بالقرب من تجمعات الغازات القابلة للاشتعال أو أبخرة الغازات. قد يؤدي التقصير في اتباع تلك التعليمات إلى اندلاع حريق أو حدوث انفجار.
- لتجنب تعرض الوحدة الداخلية للسخونة الزائدة واندلاع حرق، ضع الوحدة بعيداً (بمسافة تزيد عن ٢ متر) عن المصادر الحرارية مثل المشعات الحرارية (الرادياتورز)، والسخانات، والأفران، والمواقد، اقد، وغيرها.
- عند نقل مكيف الهواء لتركيبه في مكان آخر مجدداً، كن حذراً جداً من اختلاط سائل التبريد المحدد (R410A) أو اتصاله بأي غازات أخرى في دورة التبريد. إذا اختلط سائل التبريد بالهواء أو بأي غاز آخر فسيرتفع ضغط الغاز في دورة التبريد بطريقة غير طبيعية وسيؤدي ذلك إلى انفجار الأنبوب وحدوث إصابات بشرية.
- في حال تسرب غاز سائل التبريد إلى خارج الأنبوب أثناء عملية التركيب، قم بتهوية الغرفة بالهواء النقي على الفور. وفي حال ارتفاع درجة حرارة غاز سائل التبريد بسبب النار أو بأي سبب آخر، فسيؤدي ذلك إلى توليد غاز سام.

## تحذير

- لا تقم بتعديل الوحدة أبداً دون استخدام أدوات الأمان المخصصة لضمان السلامة أو باستبعاد مفاتيح التعشيق الآمنة.
- لا تقم بالتركيب في مكان لا يتحمل وزن الوحدة.
- فقد يتسبب سقوط الوحدة في حدوث إصابات بشرية وتلف في الممتلكات.
- قبل القيام بالأعمال الكهربائية، قم بتوصيل قابس معتمد بسلك مزود الطاقة. وتأكد أيضاً من تأريض الجهاز بطريقة صحيحة.
- يجب تركيب الجهاز وفقاً لأنظمة تركيب الأسلاك المحلية.
- إذا لاحظت أي تلف، فلا تقم بتركيب الوحدة. واتصل بالموزع على الفور.
- لا تستخدم أي سائل تبريد آخر غير سائل التبريد المحدد سواء عند تكملته أو استبداله.
- وإلا فقد يتولد ضغط مرتفع غير طبيعي في دورة التبريد وقد يؤدي ذلك إلى حدوث عطل أو انفجار بالجهاز أو وقوع إصابات شخصية بالجسم.

## التدابير الوقائية من أجل السلامة

- قبل التركيب، يرجى قراءة تدابير السلامة بعناية.
- تأكد من اتباع التدابير الوقائية المذكورة هنا لتجنب التعرض لمخاطر السلامة. الرموز ودلالاتها موضحة أدناه.
- تحذير :** يشير إلى أن الاستخدام غير الصحيح للوحدة قد يؤدي إلى إصابة شديدة أو الموت.
- تنبيه :** يشير إلى أن الاستخدام غير الصحيح للوحدة قد يؤدي إلى إصابة شخصية (\*1)، أو تضرر الممتلكات (\*2).
- \*1: الإصابة الشخصية تعني حادثاً بسيطاً، أو حروقاً، أو صدمة كهربائية لا تستدعي دخول المستشفى أو تلقي العلاج المتكرر.
- \*2: تضرر الممتلكات يعني وقوع تلف وأضرار كبيرة تؤثر على الممتلكات أو الموارد.

### للاستخدام العام الشائع

يجب أن يكون سلك مزود الطاقة وكابل التوصيل المخصص لاستخدام الجهاز مرناً ومغلفاً بمادة البولي كلوروبرين (تصميم H07RN-F) أو سلك مصنف IEC66 60245. (يجب تركيبه وفقاً لأنظمة تر كيب الأسلاك المحلية).

### تركيب مكيف تبريد الهواء الجديد

تنبيه

- يستخدم مكيف الهواء هذا سائل التبريد المكون من مركب الهيدروفلوروكربون الجديد (R410A) ، والذي لا يضر طبقة الأوزون.
- يعتبر سائل التبريد R410A عرضة للتأثر بالشوائب مثل الماء، والأغشية المؤكسدة، والزيوت نظراً لأن ضغط سائل التبريد R410A يبلغ حوالي ١,٦ مرة ضعف سائل التبريد R22. وبالإضافة إلى اعتماد سائل سائل التبريد الجديد هذا، فقد تم تغيير زيت آلة التبريد أيضاً. وبالتالي عند القيام بأعمال التركيب، تأكد من عدم دخول الماء، أو الغبار، أو سائل التبريد السابق، أو زيت آلة التبريد إلى دورة التبريد لمكيف تبريد الهواء الجديد.
- ولتجنب اختلاط سائل التبريد بزيت آلة التبريد، هناك اختلاف في حجم أجزاء توصيل منفذ التعبئة على الوحدة الرئيسية وسائل التبريد العادي، كما يتطلب التركيب استخدام أدوات ذات أحجام مختلفة. ولتوصيل الأنابيب، قم باستخدام أنابيب من خامات جديدة ونظيفة ذات إمكانيات مقاومة للضغط العالي ومصممة خصيصاً لسائل التبريد R410A، وتأكد من عدم دخول الماء أو الغبار إليه. وعلاوة على ذلك، لا تستخدم أي أنابيب موجودة قبلاً لأن مقاومتها للضغط قد تكون غير كافية كما أنها قد تحتوي على شوائب.


١	التدابير الوقائية من أجل السلامة.....
٤	القطع الملحقة.....
٥	مخطط تركيب الوجدتين الداخلية والخارجية.....
٥	■ قطع التركيب الاختيارية.....
٦	الوحدة الداخلية.....
٦	■ مكان التركيب.....
٦	■ إنشاء الفتحة وتثبيت لوح التركيب.....
٦	■ تركيب الأنابيب وخرطوم التصريف.....
٧	■ تثبيت الوحدة الداخلية.....
٨	■ التصريف.....
٨	الوحدة الخارجية.....
٨	■ مكان التركيب.....
٨	■ تصريف المياه.....
٩	■ توصيل أنابيب سائل التبريد.....
٩	■ التفريغ.....
١١	الأعمال الكهربائية.....
١١	■ توصيل الأسلاك.....
١٢	■ توصيل مزود الطاقة وكابل التوصيل.....
١٣	مواضيع أخرى.....
١٣	■ اختبار تسرب الغاز.....
١٣	■ الاختيار بين جهاز التحكم عن بعد على الإعداد A أو B.....
١٣	■ اختبار التشغيل.....
١٣	■ إعدادات إعادة التشغيل التلقائي.....
١٤	ملحق.....



**INVERTER**

# TOSHIBA

دليل التركيب  
مكيف هواء (طراز سبليت)

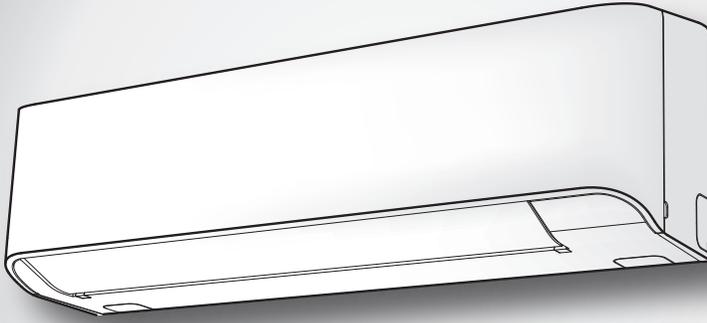

الوحدة الداخلية  
**RAS-18, 24PKCV-AE**

الوحدة الخارجية  
**RAS-18, 24PACV-AE**



1120650182-1